



(12) **EUROPEAN PATENT APPLICATION**

(43) Date of publication:
08.08.2007 Bulletin 2007/32

(51) Int Cl.:
F25B 7/00 (2006.01)

(21) Application number: **07002617.4**

(22) Date of filing: **07.02.2007**

(84) Designated Contracting States:
AT BE BG CH CY CZ DE DK EE ES FI FR GB GR HU IE IS IT LI LT LU LV MC NL PL PT RO SE SI SK TR
Designated Extension States:
AL BA HR MK YU

(71) Applicant: **Birton A/S**
8260 Viby J (DK)

(72) Inventor: **Johansen, Bent**
8220 Brabrand (DK)

(74) Representative: **Nielsen, Leif et al**
Patrade A/S
Fredens Torv 3A
8000 Aarhus C (DK)

(30) Priority: **07.02.2006 DK 200600173**

(54) **Refrigerating system using "free energy" for circulating liquid re-frigerant by pressure**

(57) The invention relates to a cascade refrigerating system comprising a primary refrigerating system operating with a first refrigerant, which primary refrigerating system comprises compressor means, connected to condensing means, where the primary refrigerating system further comprises heat exchanging means, where heat is exchanged from a secondary refrigerating system, which secondary refrigerating system comprises pumping means arranged to supply refrigerant to evaporating means and the secondary refrigerating system comprises at least two pumping vessels connected through respective check valves which pumping vessels are connected to at least one heat exchanger, in which refrigerant is evaporated to generate high pressure, which high pressure is led to the top of one of the pumping vessels for supplying refrigerant with high pressure towards the evaporation means. The purpose of the invention is to provide an energy efficient refrigerating system

that is suitable for refrigerant circulation with reduced energy consumption for circulating refrigerant in refrigerating systems, This can be achieved if the inlet at the primary side of the heat exchanger is connected directly to the outlet of the condensing means in the first refrigerating system by a permanent open line, and where the outlet from the heat exchanger is connected through a permanent open line to the inlet of the cascade heat exchanging means through pressure reduction means. It is hereby achieved that energy for circulating the refrigerant in the second refrigerating system is delivered from the sub cooling of the first refrigerating system. By a nearly unrestricted flow of the first refrigerant through the heat exchanger a simple primary refrigerant system with reduced charge of primary refrigerant and less pressure drop in primary refrigerant line can be achieved. The first refrigerant is cooled /liquefied and subcooled in the condenser means, limited by the water/air flowing through the condenser means.

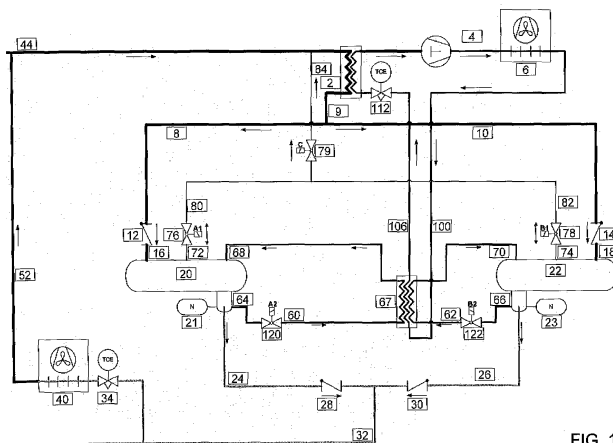


FIG. 1

Description

[0001] The invention relates to a cascade refrigerating system comprising a primary refrigerating system operating with a first refrigerant, which primary refrigerating system comprises compressor means connected to condensing means, where the primary refrigerating system further comprises heat exchanging means, where heat is exchanged from a secondary refrigerating system, which secondary refrigerating system comprises pump-
 ing means arranged to supply refrigerant to evaporating means and where the secondary refrigerating system comprises at least two pumping vessels connected through respective check valves, which pumping vessels are connected to at least one heat exchanger, in which refrigerant is evaporated to generate a high pressure, which high pressure is led to the top of one of the pumping vessels to supply refrigerant to the evaporation means.

Background of the Invention

[0002] GB 1,146,428 describes improvements in a flooded coil refrigerating system, where tanks are designed to collect a re-circulating excess refrigerant from the evaporators to eliminate slugging of the compressor. The driving force of the prior art system is the pressure difference between the compressor discharge or condenser pressure and the suction pressure of the compressor, which is similar to most other refrigerating systems. During operation one of the receivers is connected to the condenser, and liquid refrigerant fills the first receiver, which at the same time is connected through restriction means to flooded evaporators, from which refrigerant is led to the second receiver, where liquid remains and gas is led to the suction side of the compressor. When the first receiver is empty or the second receiver is full, valves are opened and closed to change the operation of the receivers.

[0003] Pumping liquid refrigerant with gas pressure systems is prior disclosed in W. F. Stoecker, Industrial refrigeration, chapter 8-8 to 8-10, page 241 to 251 and chapter 8-9, page 246-247, where energy analysis of gas pumping is described:

"Gas pumping systems are lower at first costs, require lower maintenance expense... and are not subject to cavitations. Gas pumping systems require more power for the pumping process than mechanical pumps..."

"It is generally accepted that energy cost of the gas pumping system is greater than that of the mechanical pump..."

"There is another loss associated with gas pumping ...by the warm vapour heating the cold liquid and the walls of the pumping vessel "

"All the foregoing may be summarized by estimating

that the cost of gas pumping may be 50% to 100% higher than liquid pumping.

[0004] DE 3511421 A1 describes a refrigeration circuit, which comprises adjustable means to increase the pressure in the refrigeration circuit with a low condensation temperature. This way it is possible to fulfil condensation by using very low refrigerant temperatures with a very low condensation pressure without experiencing circulation problems.

[0005] The system relates to energy savings by means of low condensing temperatures, which maintains sufficient refrigerant pressure for the expansion valve.

[0006] EP 1 046 868 A2 describes a refrigerating system having a refrigeration cycle, which provides optimised energy consumption.

[0007] Pumping pressure is generated by an auxiliary compressor, thus it is not an energy neutral system.

[0008] Every one of the above-mentioned prior art systems use compressors or pumps to generate the driving force of the pumping systems.

[0009] The disadvantages of systems using discharge gas generated by a compressor are:

- The energy consumption of the compressor,
- The energy loss originating from the warm vapour heating, the cold liquid and the walls of the pumping vessel,
- The energy loss originating from bypassing discharge gas to suction side,
- The fact that the compressor is running continuously to generate pressure,
- The capacity control of the compressor, which may be required,
- The service and maintenance of the compressor,
- The running noise of compressors,
- The compressor oil in the refrigerating system, which requires a separation and return system,
- The poor heat transfer of coils due to oil in the refrigerating system.

[0010] The disadvantages of systems using pumps are:

- The Energy consumption of the pump,
- The Energy loss by flooded evaporators and the excess refrigerant circulating,
- The Capacity control of the pump, which may be required,
- The service and maintenance of the pump,
- The running noise of the pump,
- The fact that pumps are subject to cavitations,
- The leaking shaft seal = loss of refrigerant.
- The fact that the pumps have a limited life time.

[0011] Prior art discloses the use of the gravity force for generating flow of the refrigerant. Gravity force systems can be difficult to install on site due to physical re-

strictions regarding the installation of components and the piping in buildings.

[0012] EP 1536190 A1 concerns a cascade refrigerating system comprising a first high temperature refrigerating system operating with a first refrigerant, where the first high temperature system comprises heat exchanging means, where heat is exchanged from a second low temperature refrigerating system. The second low temperature refrigerating system comprises pumping means arranged to supply refrigerant to evaporating means. The second low temperature refrigerating system may comprise at least two pumping vessels connected through respective check valves, which pumping vessels are connected to heating means in which refrigerant is evaporated to generate high pressure, which high pressure is led to the top of the pumping vessels to press refrigerant towards the evaporation means. It is hereby achieved that the liquid refrigerant evaporates and generates pressure in the related vessel as it is exposed to the heating means. This way the circulation system is able to operate with refrigerant completely without oil, since the system does not include any compressors or pumps. This leads to improved performance and improved heat transfer.

[0013] JP 2002048422 describes a natural circulation type heat pumping system comprising a cascade condenser, an ammonia refrigerant system, a carbon dioxide refrigerant system, hence a carbon dioxide gas generated by the carbon dioxide refrigerating system is guided to the capacitors 3 and heat exchanged with an ammonia liquid of the ammonia refrigerant system. The system furthermore comprises pressure tanks for containing liquefied carbon dioxide from the condensers 3 to heat the liquefied carbon dioxide via heat exchangers and to increase the pressure inside the tanks; the liquefied carbon dioxide is lifted to a surge tank installed above the evaporator of the carbon dioxide refrigerating system.

[0014] A high level surge tank 6 is necessary to secure continued flow to evaporator means.

[0015] JP 11 132507 describes a refrigerating system with improved reliability of refrigerant circulation by means of a reduction of the number of trouble occurring factor spots by means of a method according to which there is a need for a valve mechanism to switch pressurization through evaporation of a refrigerant. By means of cooling, the pressure reduction is eliminated from a device formed to generate a circulation drive force for refrigerant in a circuit by utilizing a pressure generated through heating and cooling of a refrigerant. A drive force generating circuit having a liquid receiver is connected to a liquid line of a refrigerant circuit B on the utilization side of a secondary refrigerant system. In the liquid receiver, a circuit for pressurization is formed between a pressurized heat-exchanger and the liquid receiver, and a circuit for pressure reduction is formed between a pressure heat-exchanger and the liquid receiver. A refrigerating device comprises a heater to generate high pressure through evaporation of a refrigerant by heating the pressurized heat-exchanger and a cooler to generate low

pressure through condensation of a refrigerant by cooling a pressure-reduced heat-exchanger.

[0016] Regulating the heating amount of the heater and the cooling amount of the cooler alternately generates a state to generate high pressure in the liquid receiver, and a state wherein low pressure is exerted, hence discharge of liquid from the liquid receiver, and recovery of liquid to the liquid receiver is alternately affected.

[0017] Only one pumping vessel results in non-continuous flow towards the evaporating means.

[0018] External heating means or refrigeration/heat pump systems are necessary to generate pumping pressure. Thus, it is not an energy neutral system.

[0019] EP 0857936 B1 concerns a heat exchanger on a secondary heat source exchanging heat with a heat exchanger on the primary heat source in a primary cooling circuit, and which is connected to an indoor heat exchanger through a gas pipe and a liquid pipe. A tank storing a liquid cooling medium is connected at its lower end to the liquid pipe and at its upper end to a pressure adjustment mechanism. Check valves are disposed on both sides of the connecting portion of the tank having regard to the liquid pipe. The internal pressure of the tank is either high or low and the state of the pressure changes by means of the pressure adjustment mechanism, thus the liquid cooling medium is supplied to the indoor heat exchanger, when the pressure is high, and the liquid cooling medium is recovered from the heat exchanger on the secondary side of the tank and is circulated by a secondary cooling circuit during low pressure.

[0020] External heating means or refrigeration/heat pump systems are necessary to generate pumping pressure. Thus, it is not an energy neutral system.

[0021] JP 11 023079 concerns a method according to which a natural refrigerant is used in a circulation cycle on the secondary side, a booster is arranged in a position below primary and secondary heat-exchanging parts, and a solenoid valve is arranged on the outlet side of a boosting device. A secondary refrigerant, being a natural refrigerant such as CO₂, which is radiated and condensed by a refrigerator 1 on the primary side, is fed to a heat-exchanger 2 on the secondary side by the absorbing of heat, and a substance to be cooled is cooled. A secondary refrigerant evaporated by the heat-exchanger on the secondary side is returned to the refrigerator on the primary side, and by means of its own weight it drops into a liquid reservoir situated downstream from the condensing part of the refrigerator on the primary side, and the refrigerant is stored therein. A secondary refrigerant in the liquid reservoir is supplied by means of its own weight to a booster through a check valve. When a liquid refrigerant is sufficiently stored in a booster, solenoid valves are closed. A secondary refrigerant is heated by a heating device to increase the internal pressure of the booster, and the secondary refrigerant is fed to a heat-exchanger on the secondary side through a piping on the secondary side.

[0022] The present application does not describe any pressure equalization in the tanks when alternating between tanks.

[0023] External heating means or refrigeration/heat pump systems are necessary to generate pumping pressure. Thus, it is not an energy neutral system.

Explanation of the invention

[0024] The purpose of the invention is to provide an energy efficient refrigerating system suitable for refrigerant circulation with reduced energy consumption for the circulation of refrigerant in refrigerating systems.

[0025] This can be achieved with a system as described in the opening paragraph if the cascade refrigeration is modified so that the inlet at the primary side of the heat exchanger is connected directly to the outlet of the condensing means in the first refrigerating system by a permanent open line, and where the outlet from the heat exchanger is connected through a permanent open line to the inlet of the cascade heat exchanging means through pressure reduction means.

[0026] It is hereby achieved that energy for circulating the refrigerant in the secondary refrigerating system is delivered from subcooling of the primary refrigerating system. By a nearly unrestricted flow of the first refrigerant through the heat exchanger it can be achieved that a simple primary refrigerant system with reduced charge of primary refrigerant and less pressure drops in the primary refrigerant line. The first refrigerant is cooled/liquefied and subcooled in the condenser means and reduced by the temperature of the water/air flowing through the condenser means. By passing of the heat exchanger, the liquefied refrigerant is further subcooled, and the content of the cooling energy is increased. The energy for generating pressure in the secondary refrigerating system is removed from the first refrigerating system, making this application energy neutral. When the secondary liquid refrigerant is exposed to heat in the heat exchanger, it evaporates and generates pressure in the related vessel. This way the circulation system can operate with refrigerant completely without oil since the system does not include any compressors or pumps. This leads to better performance and better heat transfer.

[0027] The heat exchanger has an inlet for the second refrigerant, which is connected to the lower part of the pumping vessels, where the heat exchanger has an outlet connected to the upper part of the pumping vessels. It is hereby achieved that liquid secondary refrigerant is supplied by gravity from at least one of two pumping vessels to a related heat exchanger located in the same level as the lower part of the pumping vessels.

[0028] It is hereby achieved that the refrigerant is injected into one or more heat exchangers where the pressurized gas is produced by evaporating the second refrigerant. This way a pressure difference is provided, which pressure difference has enough force to press refrigerant through the refrigerating system.

[0029] The pressurized gas produced by the evaporating secondary refrigerant is supplied into the vessel acting as high pressure. The high pressure of the contained liquid refrigerant makes the liquid refrigerant flow through non-return valves into the liquid line.

[0030] Mean while a solenoid valve equalizes the pressure between the condenser and the other vessel, which makes the refrigerant fill the vessel by gravity.

[0031] When the high pressure vessel is empty, a control circuit makes the sequence alter so the second vessel supplies liquid and the first vessel fill up.

[0032] According to a preferred embodiment, the upper part of the pumping vessels can be connected through a line, which line contains solenoid valves towards the vessels from where the line is further connected to the return line from the evaporators through a solenoid valve. Thus, it can be achieved that liquid refrigerant in one of the vessels can be pressurized from the other vessel. Each time a change is noticed between the vessels, the empty vessel has a high pressure and the full vessel has a low pressure, the pressure can be aligned to reduce the total power consumption of the refrigerating system. This can also reduce the time for alternating between the tanks and ensure a nearly constant flow to the evaporating means.

[0033] According to a second preferred embodiment, a common heat exchanger may comprise a first section, which first section is connected to the permanent open line, where a second and third section of the common heat exchanger is connected to the pumping vessels. Hereby is achieved that there can be a constant flow of the first refrigerant through the common heat exchanger, and the entire refrigerant leaving the cascade condenser is flowing through the common heat exchanger.

[0034] By controlling the heating means by solenoid valves in secondary refrigerant flowing from the lower parts from the vessels by gravity, control can be performed by small and less expensive solenoids valves.

[0035] The material of the heat exchanger is always pre-heated by the primary refrigerant, ensuring a quick heating action.

[0036] As an alternative a first and a second heat exchanger is serially coupled and connected to the permanent open line. Hereby standard heat exchangers may be used as long as a mostly unrestricted flow of the first refrigerant is achieved through the serially coupled heat exchangers.

[0037] The invention further relates to a method for operating a refrigerating system with free energy, which refrigerating system can be operated by at least two pumping means to supply refrigerant to evaporating means through expansion means, where the refrigerant flows from the evaporators through condensing means, from where the refrigerant flows back towards the pumping means, which pumping means can be pressurized by evaporating refrigerant in at least one heat exchanger for supplying refrigerant at high pressure towards the evaporation means, where the heat exchanger can be

heated primarily by free energy flowing towards and away from the heat exchanger through permanent open lines.

[0038] Hereby it can be achieved that all kinds of free energy can be used to pump the refrigerant around the refrigerating system.

[0039] Free energy can be achieved by connecting the heat exchanger to refrigerant flowing to or from a condensing means operating with sufficient high temperature. The heating energy for generating pumping pressure of the secondary refrigerant is removed from the primary refrigerating system, which makes the circulation system work with "free energy" without any external energy source.

[0040] "Free energy" for generating pumping pressure of the secondary refrigerant can be achieved by connecting the heat exchanger to refrigerant flowing to or from a condensing means operating with sufficient high temperature. The heating energy for generating pumping pressure of the secondary refrigerant is removed from the primary refrigerating system, which makes the circulation system work with "free energy" without any external energy source.

[0041] "Free energy" for generating pumping pressure of the secondary refrigerant can be achieved by superheating the suction gas from the evaporating means or from additional superheating means, which makes the circulation system work with "free energy" from the cooling load without any external energy source.

[0042] Hereby is achieved that there is not any or at least very small energy costs connected with the circulation of refrigerant.

[0043] Additional heating means can be added, if there is not sufficient superheated gas available.

[0044] As an alternative heating energy for generating pumping pressure of the secondary refrigerant can be achieved by heating the heat exchanger by any (waste) energy flowing in a liquid or gaseous media through lines to and from the heat exchanger.

The described systems can provide pressurized circulation of the secondary refrigerant of rotating parts in pumps or compressors and the refrigerating system requires limited regular maintenance.

Drawings

[0045] In the following, the refrigerating system is described according to the figure, where fig. 1 shows an embodiment of the invention comprising compressor means where

fig. 2 shows an alternative embodiment of the invention, where

fig. 3 describes a third embodiment of the invention, where

fig. 4 shows an alternative embodiment of the invention.

[0046] Fig. 1 shows a first cascade refrigerating system, where the cascade heat exchanger 2 is cooled by a primary refrigerating system 4. The primary refrigerating system 4 can be any suitable system using any suit-

able refrigerant. The heat exchanger 2 functions as the cascade condenser of the secondary refrigerating system. Liquid flows through the pipe 9 and alternates further through the pipe 8 or 10, which leads to non-return valves 12 or 14 and through the pipe 16 or 18 into the pumping vessels 20 or 22. The outlet of the pumping vessels 20 or 22 are connected through pipe 24 or 26, through non-return valves 28 or 30 into the liquid line 32, which leads to flow restriction means 34, which restriction means might be electronically controlled expansion valves. From the restriction means 34, the secondary refrigerant is led to evaporators 40. The outlet pipes 52 from the evaporator 40 are led to the cascade condenser 2.

[0047] A part stream of the liquid secondary refrigerant is led from the pumping vessels 20 or 22 through magnetic valves 120 and 122 and into the pipe 60 or 62 into one of the sections of a common heat exchanger 67, where liquid secondary refrigerant is evaporated when exposed to a heat source. The evaporated refrigerant gas is led back to the related vessels 20, 22 through the pipes 68, 70 generating pressure for the operation of the system.

[0048] The common heat exchanger is heated by liquid primary refrigerant. The entire liquid primary refrigerant leaves the cascade condenser through line 100 and is led to the central section of the common heat exchanger 67 from which the now subcooled primary refrigerant flows through line 106 towards the cascade expansion valve 112.

[0049] The vessel 20, 22 will in loading mode equalize pressure through pipe 72, 74, onto the solenoid valves 76, 78, through the pipes 80, 82, 84 into the common return line 52 or 44.

[0050] Operation example: The vessel 20 operates at high pressure when supplying liquid and the vessel 22 operates at low pressure when loading liquid. The solenoid valve 76 is closed and the liquid is trapped inside the HP vessel 20. Due to the high pressure, the inlet non-return valve 12 is closed and the outlet non-return valve 28 is open. By opening the solenoid valve 120, the trapped liquid is heated/evaporated by the heat exchanger 67, generating high pressure. The solenoid valve 78 and 79 are open so the pressure of vessel 22 is equalized to the condenser 2 and the liquid is drained by gravity from the condenser 2 through non-return valve 14 to vessel 22. When the HP vessel (20) is empty, the system alternates. The system is controlled by a monitoring device 21, 23 or by means of a timer (not shown).

[0051] The solenoid valve 79 in the common venting line 84 closes both the solenoid valves 76 and 78 equalizing the pressure between vessel 20 and 22. When the pressure is equalized, the solenoid valve 78 closes, solenoid valves 76 and 79 opens and vessel 22 is now in operation as HP vessel supplying liquid. By opening the solenoid valve 122 the trapped liquid is heated/evaporated by the heat exchanger 67 generating high pressure. The solenoid valve 76 and 79 are open so the pressure of vessel 20 is equalized to the condenser 2 and the liquid

is drained by gravity from the condenser 2 through non-return valve 12 to vessel 20. When the HP vessel (22) is empty, the system alternates again. Thus, the system can operate by changing between an active (supplying) and an inactive (loading) vessel during the entire operation. This leads to a highly efficient refrigerating system, where a liquid refrigerant is circulated in the piping by means of pressure using free or "low value" energy without using any energy consuming pumps, compressor etc. [0052] Fig. 2 shows an alternative embodiment of the invention. Most of the functions of the second refrigerating system are equal to those shown in fig. 1, thus they will not be mentioned. The only differences between fig. 1 and 2 will be mentioned in the following.

[0053] The major difference is that the common heat exchanger 48 in fig. 2 is connected differently than in fig. 1. The common heat exchanger 48 is supplied through a line 46, where the secondary refrigerant returns mostly as a gas from the evaporator 40.

[0054] The heating energy for generating pumping pressure of the secondary refrigerant can be achieved by superheating the suction gas from the evaporating means 40 or from additional superheating means 42, which makes the circulation system work with "free energy" from the cooling load without any external energy source. Additional heating means can be added, if there is not sufficient superheated gas available (not shown).

[0055] The superheated refrigerant is led through line 46 to the common heat exchanger 48, where refrigerant is heated/evaporated in the other parts of the heat exchanger. The refrigerant leaves through line 50, which leads towards the condenser 2.

[0056] Fig. 3 describes a third embodiment of the invention by showing a combination of the features from fig. 1 and fig. 2. Two common heat exchangers 48 and 67 are used. The common heat exchanger 48 operates as described in fig. 2, and the common heat exchanger 67 operates as described in fig. 1. This way the two exchangers can operate parallel with two different "free energy" heat sources.

[0057] This combination of the two different "free energy" heat sources can allow the refrigerating system to operate, even if the primary refrigerating system is stopped.

[0058] Fig. 4 shows an alternative embodiment, which is very much like the system shown in fig. 3, thus only the differences will be described. The only difference is that additional cooling/condenser means are shown, which can operate parallel to the condenser 2 to condense the secondary refrigerant. The cooling/condenser means 92 could i.e. be an outdoor "free cooling" coil, which during winter can reduce the temperature of the refrigerant so that condensing is performed.

[0059] This can allow the primary refrigerating system to be stopped or be operated at reduced capacity, which can lead to significant energy savings.

[0060] When the total system operates on "free energy" and in "free-cooling" mode, the external power re-

quirements are limited to minor consumers in the control system (solenoid valves etc.) and i.e. blowing means in the evaporator 40, additional super heater 42 and blowing means in the cooling means 92, if any.

Claims

1. A cascade refrigerating system (4) comprising a primary refrigerating system operating with a first refrigerant, which primary refrigerating system comprises compressor means, connected to condensing means, where the primary refrigerating system further comprises heat exchanging means (2), where heat is exchanged from a secondary refrigerating system, which, secondary refrigerating system comprises pumping means arranged to supply refrigerant to evaporating means (40), where the secondary refrigerating system comprises at least two pumping vessels (20, 22) connected through respective check valves (12, 14, 28, 30), which pumping vessels (20, 22) are connected to at least one heat exchanger (67), in which refrigerant is heated/evaporated for generating a higher pressure, which higher pressure is led to the top of one of the pumping vessels (20, 22) for supplying refrigerant with high pressure to the evaporation means (40), **characterised in that** the inlet at the primary side of the heat exchanger (67) is connected directly to the outlet of the condensing means in the first refrigerating system by a permanent open line (100), and where the outlet from the heat exchanger (67) is connected through a permanent open line (106) to the inlet of the heat exchanging means (2) through pressure reduction means (112).
2. A cascade refrigerating system according to claim 1 **characterised in, that** the heat exchanger (67) has an inlet (60, 62) for the secondary refrigerant connected to the lower part of the pumping vessels (20, 22) through flow controlling means (120, 122), where the heat exchanger has an outlet (68, 70) connected to the upper part of the pumping vessels (20, 22).
3. A cascade refrigerating system according to one of the claims 1-2, **characterised in that** the second refrigerant is supplied by gravity in a mostly liquid form from at least one of the pumping vessels (20, 22) through an outlet to a related heat exchanger (67), which heat exchanger (67) is located below the level of the pumping vessel (20, 22).
4. A cascade refrigerating system according to one of the claims 1-3, **characterised in that** the upper part of the pumping vessels (20, 22) is connected through a line (72, 74), which line contains flow controlling means (76, 78) towards the vessels (20, 22), where the line (80, 82) is further connected to the return

line from the evaporators through flow control means (79).

5. A cascade refrigerating system according to one of the claims 1-4, **characterised in that** a common heat exchanger (67) comprises a first section, which first section is connected to the permanent open lines (100, 106), where a second and third section of the common heat exchanger(67) are connected to the pumping vessels (20, 22). 5
10
6. A cascade refrigerating system according to one of the claims 1-4, **characterised in that** a first and a second heat exchanger are coupled serially and connected to the permanent open lines (100, 106). 15
7. Method for operating a refrigerating system with free energy, which refrigerating system is operated by at least two pumping means (20, 22) for supplying refrigerant to evaporating means (40) through expansion means, where the refrigerant flows from the evaporators through condensing means, from where the refrigerant is flowing towards the pumping means, which pumping means (20, 22) are pressurized by evaporating refrigerant in at least one heat exchanger (67), for supplying refrigerant with high pressure towards the evaporation means (40), where the heat exchanger (67) is heated primarily with a free energy flowing towards and away from the heat exchanger through permanent open lines (100, 106). 20
25
30
8. Method according to claim 7, **characterised in that** free energy is achieved by connecting the heat exchanger to refrigerant flowing to or from a condensing means operating at a sufficient high temperature. 35
9. Method according to claim 7, **characterised in that** free energy is achieved by heating the heat exchanger by waste energy flowing in a liquid or gaseous media through lines to and from the heat exchanger. 40

45

50

55

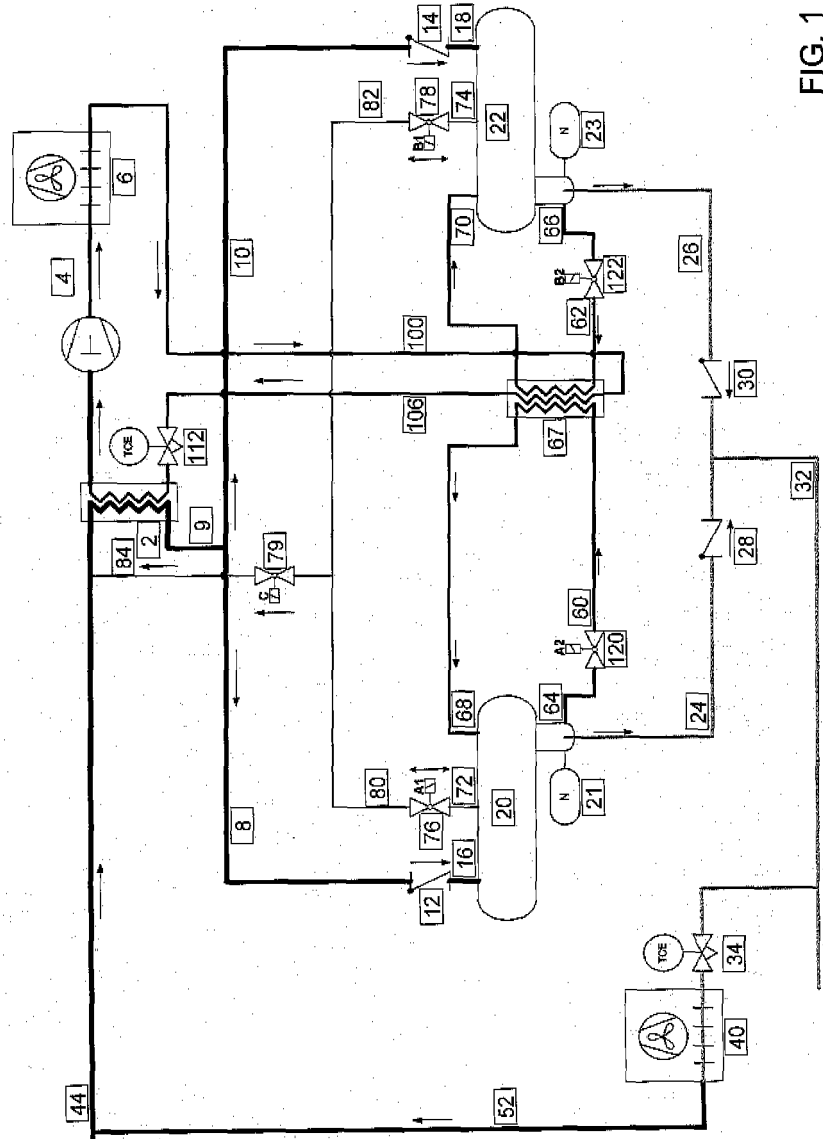


FIG. 1

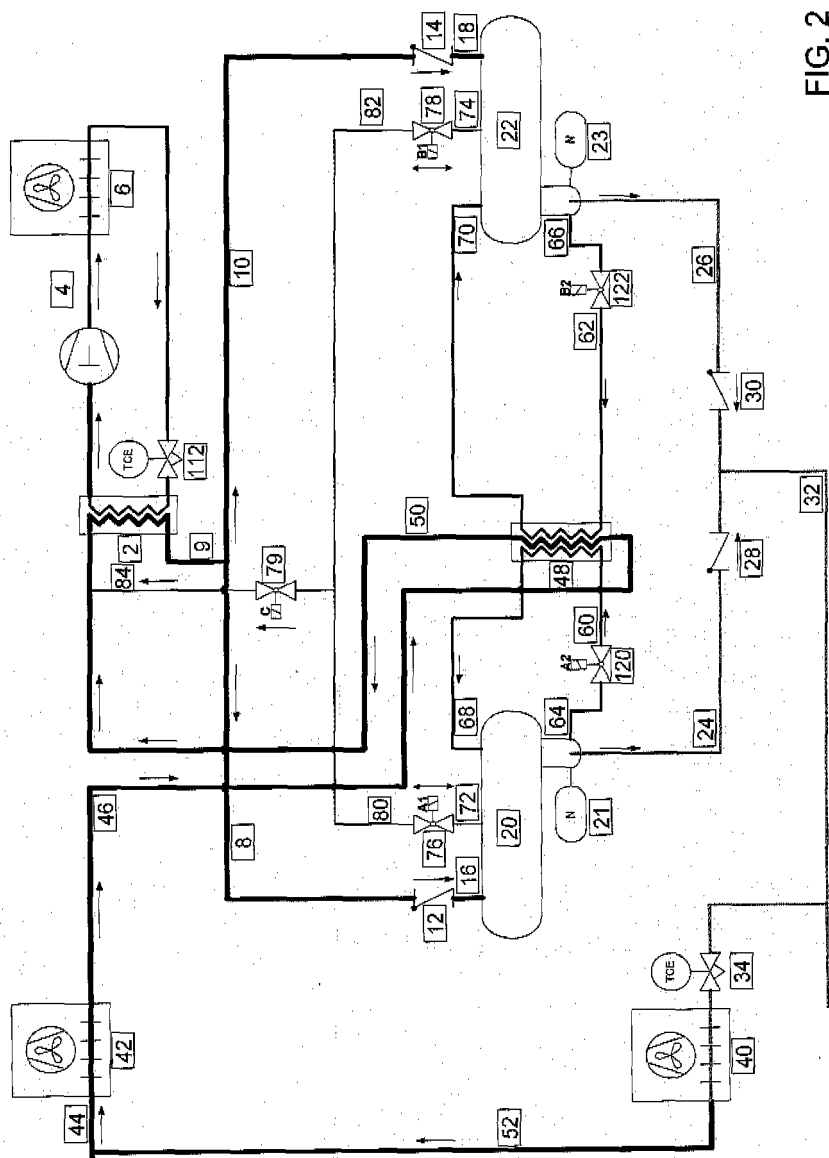


FIG. 2

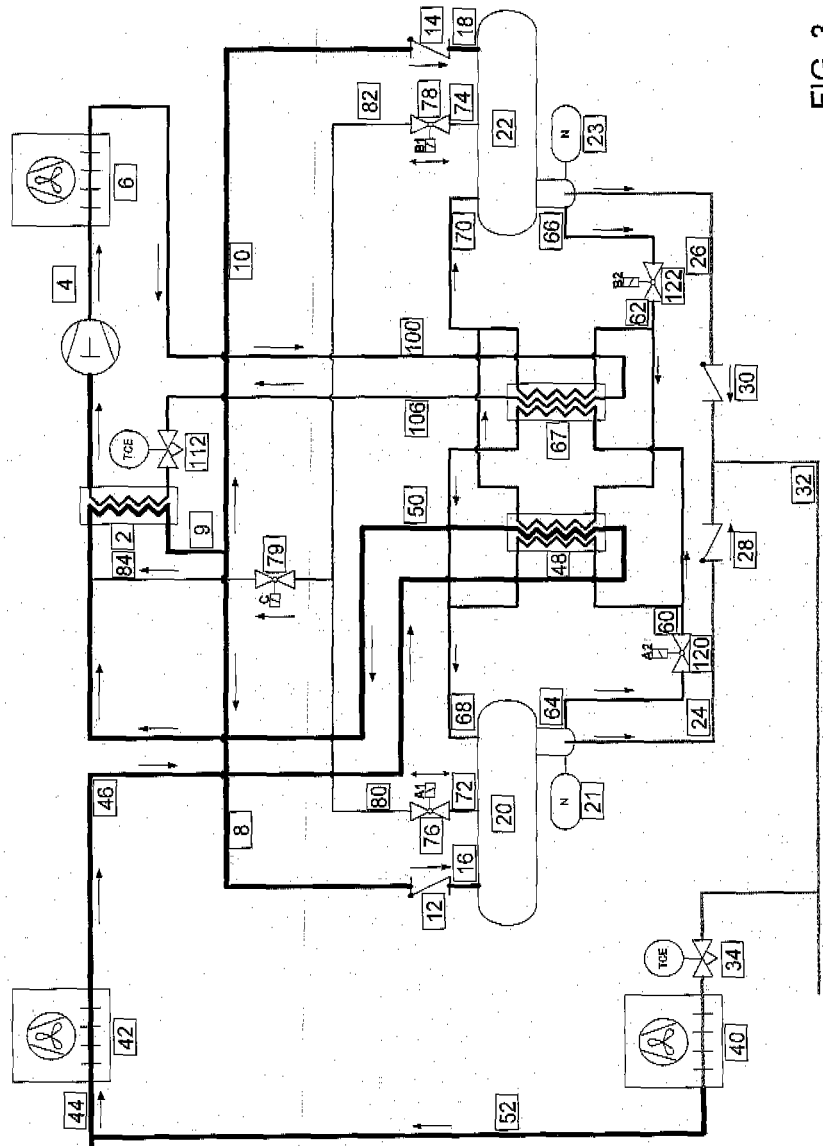


FIG. 3

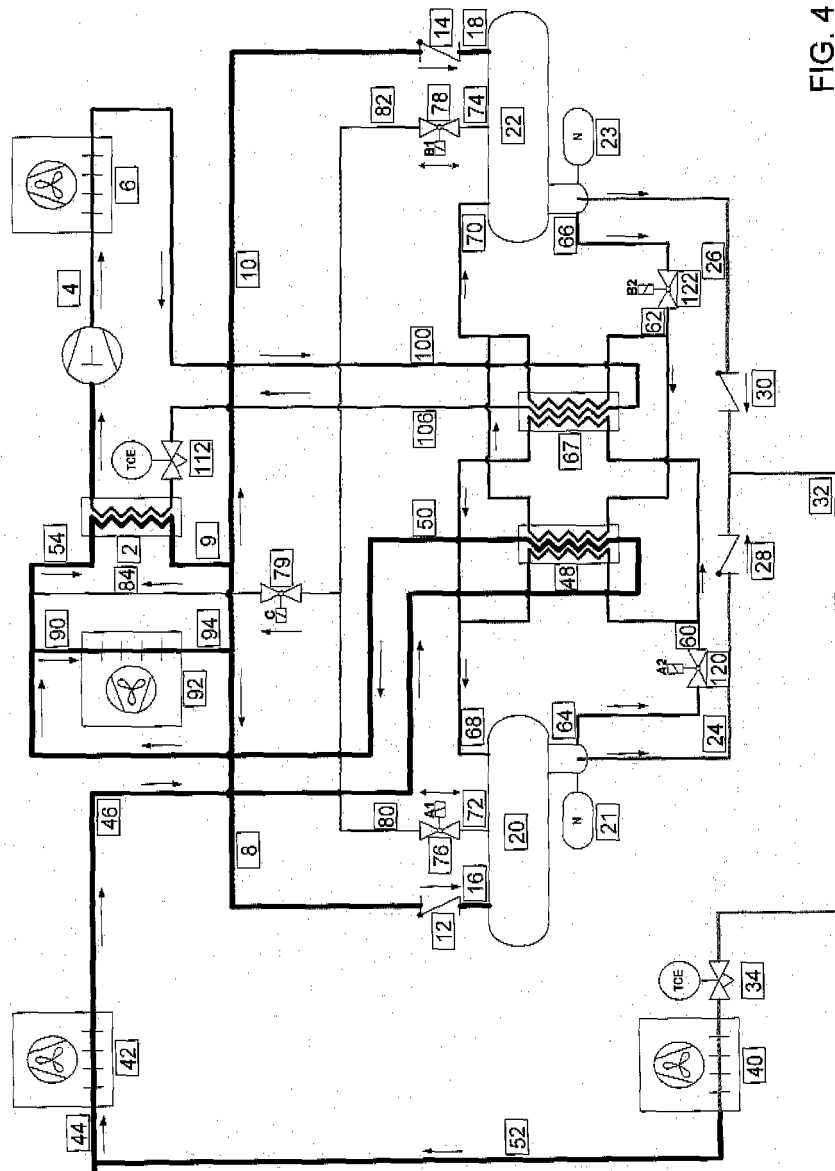


FIG. 4

REFERENCES CITED IN THE DESCRIPTION

This list of references cited by the applicant is for the reader's convenience only. It does not form part of the European patent document. Even though great care has been taken in compiling the references, errors or omissions cannot be excluded and the EPO disclaims all liability in this regard.

Patent documents cited in the description

- GB 1146428 A [0002]
- DE 3511421 A1 [0004]
- EP 1046868 A2 [0006]
- EP 1536190 A1 [0012]
- JP 2002048422 B [0013]
- JP 11132507 A [0015]
- EP 0857936 B1 [0019]
- JP 11023079 A [0021]

Non-patent literature cited in the description

- **W. F. STOECKER.** Industrial refrigeration. 241-251 [0003]
- **INDUSTRIAL REFRIGERATION.** 246-247 [0003]