

(19)



(11)

EP 3 376 126 B1

(12)

EUROPEAN PATENT SPECIFICATION

(45) Date of publication and mention
of the grant of the patent:

13.09.2023 Bulletin 2023/37

(21) Application number: **16864307.0**

(22) Date of filing: **10.11.2016**

(51) International Patent Classification (IPC):

F24F 11/49 ^(2018.01) **F24F 1/0068** ^(2019.01)

(52) Cooperative Patent Classification (CPC):

F24F 11/49; F24F 1/0068; F24F 2221/54

(86) International application number:

PCT/JP2016/083368

(87) International publication number:

WO 2017/082346 (18.05.2017 Gazette 2017/20)

(54) **AIR CONDITIONING SYSTEM**

KLIMATISIERUNGSSYSTEM

SYSTÈME DE CONDITIONNEMENT D'AIR

(84) Designated Contracting States:

**AL AT BE BG CH CY CZ DE DK EE ES FI FR GB
GR HR HU IE IS IT LI LT LU LV MC MK MT NL NO
PL PT RO RS SE SI SK SM TR**

(30) Priority: **12.11.2015 JP 2015221940**

(43) Date of publication of application:

19.09.2018 Bulletin 2018/38

(73) Proprietor: **Toshiba Carrier Corporation**

Kawasaki-shi, Kanagawa 212-8585 (JP)

(72) Inventor: **MATSUBARA Kentaro**

Fuji-shi

Shizuoka 416-8521 (JP)

(74) Representative: **AWA Sweden AB**

Junkersgatan 1

582 35 Linköping (SE)

(56) References cited:

EP-A1- 2 634 513 JP-A- H06 300 397

JP-A- 2002 147 824 JP-A- 2013 160 478

JP-A- 2013 181 697 JP-A- 2014 074 533

JP-B2- 3 216 435

Note: Within nine months of the publication of the mention of the grant of the European patent in the European Patent Bulletin, any person may give notice to the European Patent Office of opposition to that patent, in accordance with the Implementing Regulations. Notice of opposition shall not be deemed to have been filed until the opposition fee has been paid. (Art. 99(1) European Patent Convention).

Description

[Technical Field]

[0001] Embodiments of the present invention relate to an air conditioning system.

[0002] Priority is claimed on Japanese Patent Application No. 2015-221940, filed November 12, 2015.

[Background Art]

[0003] Conventionally, an air conditioning system in which a plurality of indoor units are connected to one outdoor unit through a refrigerant pipe and a communication line is known. In this type of air conditioning system, in some cases, it is determined whether or not the connection between the pipe and the communication line is correct, on the basis of a change in the refrigerant temperature before and after supplying the refrigerant to the pipe which is acquired from a sensor that detects a refrigerant temperature via a heat exchanger. JP3216435B2 relates to a multi-type air-conditioning machine.

[Citation List]

[Patent Literature]

[Patent Document 1]

[0004] Japanese Unexamined Patent Application, First Publication No. H5-33982

[Summary of Invention]

[Technical Problem]

[0005] However, in this conventional air conditioning system, there is a case in which it is not possible to accurately determine whether the pipe or the communication line is correctly connected.

[0006] An object to be solved by the present invention is to provide an air conditioning system capable of more accurately determining whether a pipe or a communication line is correctly connected.

[Solution to Problem]

[0007] The invention is defined by the appended claims.

[0008] An air conditioning system according to an embodiment includes an outdoor unit, a first indoor unit, a second indoor unit, a first temperature determination unit, a second temperature determination unit, a third temperature determination unit, a fourth temperature determination unit, and a control unit. The outdoor unit has at least a compressor and is connectable to a refrigerant pipe system. The first indoor unit has a first heat exchanger

and is connectable to the refrigerant pipe system. The second indoor unit has a second heat exchanger and is connectable to the refrigerant pipe system. The first temperature determination unit is configured to determine the temperature of the first heat exchanger. The second temperature determination unit is configured to determine the temperature of the second heat exchanger. The third temperature determination unit is provided for the first indoor unit and configured to determine the temperature of an air conditioning target space associated with the first indoor unit. The fourth temperature determination unit is provided for the second indoor unit and configured to determine the temperature of an air conditioning target space associated with the second indoor unit. The control unit configured to determine whether at least one of a first refrigerant pipe connected to the first indoor unit of the refrigerant pipe system connected to the first indoor unit and a first communication line connected to the first indoor unit is correctly connected, when a first temperature difference between the temperature determined by the first temperature determination unit and the temperature determined by the third temperature determination unit is equal to or higher than a first threshold value, and a second temperature difference between the temperature determined by the second temperature determination unit and the temperature determined by the fourth temperature determination unit is less than a second threshold value.

[Brief Description of Drawings]

[0009]

Fig. 1 is a diagram showing a configuration of an air conditioning system 1.

Fig. 2 is a diagram showing a configuration of a control unit of the air conditioning system 1.

Fig. 3 is a flowchart showing a flow of processing of a check operation executed by an outdoor side control unit 28.

Fig. 4 is a diagram showing an overview of the check operation performed by the outdoor side control unit 28.

Fig. 5 is a flowchart showing the flow of a determining process executed by the outdoor side control unit 28.

Fig. 6 is a flowchart showing the flow of processing executed by the outdoor side control unit 28 according to a second embodiment.

Fig. 7 is a diagram showing an overview of a check operation performed by an outdoor side control unit 28 according to the second embodiment.

[Description of Embodiments]

[0010] Hereinafter, an air conditioning system of an embodiment will be described with reference to the drawings.

(First embodiment)

[0011] Fig. 1 is a diagram showing a configuration of an air conditioning system 1. The air conditioning system 1 may include an outdoor unit 10, and indoor units 30-1, 30-2, ... 30-n. Hereinafter, when the indoor units are not distinguished from other indoor units, they are simply referred to as indoor units 30. The indoor units 30 are installed, for example, in different rooms. The outdoor unit 10 and each indoor unit 30-1 are connected to connection pipes 2-1-1, 2-1-2, ... 2-n-2.

[0012] The outdoor unit 10 includes a compressor 12, an accumulator 13, a four-way valve 14, an outdoor side heat exchanger 16, and expansion valves 18-1 to 18-n.

[0013] The compressor 12 compresses the refrigerant and discharges the refrigerant to the refrigerant pipe 20 via the four-way valve 14. The compressor 12 circulates the refrigerant in the direction of an arrow in the drawing. The refrigerant is, for example, R410A, or R32. Further, the refrigerant may be a refrigerant containing 50% or more of R32. In the drawings, white arrows indicate the flow of the refrigerant at the time of cooling, and black arrows indicate the flow of the refrigerant at the time of heating. In the present embodiment, as an example, the operation during cooling of the air conditioning system 1 will be mainly described. The accumulator 13 is provided to be adjacent to the compressor 12. The accumulator 13 separates the refrigerant returning to the compressor 12 into a gas-phase refrigerant and a liquid-phase refrigerant.

[0014] The four-way valve 14 switches the direction in which the refrigerant discharged from the compressor 12 is circulated. The four-way valve 14 switches between a state in which the compressor 12 and the outdoor side heat exchanger 16 are electrically connected to each other, and a state in which the compressor 12 and the indoor side heat exchanger 32 are electrically connected to each other. For example, the four-way valve 14 may circulate the refrigerant discharged from the compressor 12 to the outdoor side heat exchanger 16. Further, the four-way valve 14 circulates the refrigerant discharged from the compressor 12 to the connection pipes 2-1-1 and 2-n-1.

[0015] The four-way valve 14, the outdoor side heat exchanger 16, and the expansion valves 18-1 to 18-n are connected to each other via the refrigerant pipes 20 and 21. When the expansion valves 18-1 to 18-n are not distinguished, they are simply referred to as expansion valves 18. The outdoor side heat exchanger 16 liquefies the refrigerant discharged from the compressor 12 and releases the heat contained in the refrigerant. The expansion valve 18 is connected to the indoor unit 30 via the connection pipe 2. The expansion valve 18 sets the temperature of the liquid refrigerant to low and sets the pressure of the liquid refrigerant to low, by controlling the pressure reduction and the flow rate of the refrigerant which has become the liquid discharged from the outdoor side heat exchanger 16.

[0016] The indoor unit 30 includes an indoor side heat

exchanger 32, a fan 34, an indoor side heat exchanger temperature sensor 36, and an indoor side temperature sensor 38. The indoor side heat exchanger 32 performs heat-exchange between the refrigerant discharged from the expansion valve 18 and air to evaporate the refrigerant. The fan 34 blows the air having undergone heat exchange via the indoor side heat exchanger 32 to an air conditioning target space.

[0017] The indoor side heat exchanger temperature sensor 36 determines the temperature of the indoor side heat exchanger 32. The indoor side temperature sensor 38 determines the temperature of the room in which the indoor unit 30 is installed.

[0018] Fig. 2 is a diagram showing a configuration of a control unit of the air conditioning system 1. In addition to the configuration described in Fig. 1, the air conditioning system 1 further includes an outdoor side operation unit 26, an outdoor side control unit 28, an indoor side operation unit 40, and an indoor side control unit 42. The outdoor side control unit 28 and the indoor side control unit 42 are connected to each other through a communication line and an electrical line.

[0019] The outdoor side control unit 28 or the indoor side control unit 42 is, for example, a processor such as a central processing unit (CPU). In addition, the outdoor side control unit 28 or the indoor side control unit 42 may be hardware such as a large scale integration (LSI) or an application specific integrated circuit (ASIC).

[0020] The outdoor side operation unit 26 includes a mode switching button, a display unit, and the like. The outdoor side operation unit 26 supplies a signal corresponding to the operation of the user to the outdoor side control unit 28. When the check operation is instructed, the outdoor side operation unit 26 supplies a signal indicating that the instruction for the check operation has been given to the outdoor side control unit 28. The check operation is an operation of determining whether or not the pipe and the communication line between the outdoor unit 10 and the indoor unit 30 are connected normally (correctly)(details will be described later). Further, the display unit of the outdoor side operation unit 26 displays the results of the check operation or information indicating the abnormality of an air conditioning system 1.

[0021] Indoor side operation units 40 are provided to correspond to each of the plurality of indoor units 30. The indoor side operation unit 40 includes a setting temperature changing button of an air conditioning target space of the indoor unit 30, an operation mode switching button, an indoor side display unit, and the like. The indoor side operation unit 40 supplies a signal corresponding to the user's operation to the indoor side control unit 42. The display unit of the indoor side operation unit 40 displays the operation state of the indoor unit 30, the state of the air conditioning target space, the set operation mode, and the like.

[0022] The outdoor side control unit 28 controls the driving of the compressor 12. The outdoor side control unit 28 controls an opening degree of the valve of the

expansion valve 18. The outdoor side control unit 28 generates an instruction signal, on the basis of the signal supplied from the indoor side operation unit 40 or information acquired from the indoor side control unit 42. The outdoor side control unit 28 supplies instruction signals to the compressor 12, the expansion valve 18, the outdoor side operation unit 26, and the indoor side control unit 42. Details of processes of the outdoor side control unit 28 will be described later.

[0023] Indoor side control units 42 are provided to correspond to each of the plurality of indoor units 30. The indoor side control unit 42 controls each unit included in the indoor unit 30 on the basis of an instruction signal supplied from the outdoor side control unit 28. The indoor side control unit 42 supplies information or signals acquired from the indoor side heat exchanger temperature sensor 36, the indoor side temperature sensor 38, and the indoor side operation unit 40 to the outdoor side control unit 28.

[0024] Fig. 3 is a flowchart showing the flow of a check operation (determination of whether or not the connection of the pipe or the communication line is normal) executed by the outdoor side control unit 28. First, the outdoor side control unit 28 selects an indoor unit 30 in which the determination of the connection state has not been completed, among the plurality of indoor units 30 (step S100).

[0025] The outdoor side control unit 28 controls the fan 34 of the indoor unit 30 selected in step S100 in an ON state (step S102), and controls the expansion valves 18 of all the indoor units 30 in an open state (step S104). The outdoor side control unit 28 controls the air conditioning system 1 in a standby state for a predetermined time (step S106). Next, the outdoor side control unit 28 executes a determining process of the connection state (step S108). Details of the determining process will be described later.

[0026] Next, the outdoor side control unit 28 determines whether or not the connection state of all the indoor units 30 has been determined (step S110). When the connection state of all the indoor units 30 has not been determined, the process returns to step S100. When the connection state of all the indoor units 30 has been determined, the process of the flowchart ends.

[0027] Fig. 4 is a diagram showing an overview of the check operation performed by the outdoor side control unit 28. For example, an indoor unit 30-1 having a room A as an air conditioning target space, an indoor unit 30-2 having a room B as an air conditioning target space, and an indoor unit 30-3 having a room C as an air conditioning target space will be described as being subjected to the check operation. Also, it is assumed that the determining process is executed one by one in order from the room A to the room C. In the shown example, the temperature change (TC-A to TC-C in the drawings) of the indoor side heat exchanger 32 in the chambers A and C from the start to the end of the check operation is shown. In addition, the open and closed states (PMV A to PMV C in the drawings) of the expansion valve 18 which circulates

the refrigerant in the chambers A and C for each time, and the operation state of the compressor 12 for each time are shown.

[0028] First, the outdoor side control unit 28 controls the compressor 12 in an ON state, and controls the expansion valve 18, which circulates the refrigerant in the indoor unit 30-1, in a predetermined open state. The outdoor side control unit 28 executes the determining process of the room A, and when the determining process of the room A ends, the outdoor side control unit 28 sets the compressor 12 to an OFF state and controls at least the fan 34 of the indoor unit 30-2 to the ON state. Here, the fans 34 of all the indoor units 30-1 and 30-3 may be controlled to the ON state. Further, the outdoor side control unit 28 controls the expansion valves 18 of the indoor units 30-1 and 30-3 to the open state. These states are maintained for a predetermined time. Hereinafter, the interval time indicates the time for maintaining the compressor 12 is in the OFF state, maintaining at least the fan 34 of the indoor unit 30 as being subjected to the determining process of the connected state next is in the ON state, and maintaining all the expansion valves 18 is in the open state for the predetermined time.

[0029] The interval time is, for example, the time which is set for returning from the lowered temperature, on the assumption that the temperature of the indoor side heat exchanger 32 of the indoor unit 30-2, which becomes the target of the determining process of the connection state next, is lowered during the determining process of the indoor unit 30-1 which is the target of the immediately preceding determining process. The interval time may be a preset time. Further, the interval time may be a time determined by the outdoor side control unit 28 on the basis of the detection results of the indoor side heat exchanger temperature sensor 36 or the indoor side temperature sensor 38.

[0030] By controlling the fan 34 to the ON state during the interval time, the temperature of the indoor side heat exchanger 32 of the indoor unit 30 or the air conditioning target space is easily returned to that of a state before the determining process of the connection state was started. Further, by controlling the expansion valves 18 of the indoor units 30-1 to 30-3 to the open state, it is possible to suppress the temperature change or the like occurring in the indoor unit 30 connected to the part other than the pipe in which the refrigerant is circulated by the residual refrigerant in the pipe or the pressure change in the pipe.

[0031] After elapse of the interval time, the determining process of the connection state of the room B is executed, and after the interval time has elapsed, the determining process of the connection state of the room C is executed. Thus, it is determined whether or not the pipe of the indoor unit 30 connected to the outdoor unit 10 and the communication line are connected normally.

[0032] In the air conditioning system 1 of the embodiment, an indoor side expansion valve may be further provided between the connection pipe 2 of the indoor unit

30 and the indoor side heat exchanger 32, in addition to the expansion valve 18. In this case, when the determining process of the connection state is executed, an indoor side expansion valve different from the indoor side expansion valve included in the indoor unit 30 subject to the determining process may be controlled to the closed state. Thus, it is possible to reduce the influence of residual refrigerant and pressure change occurring in the indoor unit 30 other than the determination target through the determining process of the connection state.

[0033] Fig. 5 is a flowchart showing the flow of a determining process executed by the outdoor side control unit 28. First, the outdoor side control unit 28 controls the compressor 12 for the ON state and controls the expansion valve 18-1 of the indoor unit 30-1, which is a determination target of the connection state, to the predetermined open state (step S150). Here, the indoor unit 30-1, which is a determination target for the connection state, corresponds to the "first indoor unit" in the claims, and the indoor units 30-2 and 30-3 which are not determination targets of the connection state correspond to "an indoor unit other than the first indoor unit" in the claims. The indoor side heat exchanger 32-1 corresponds to the "first heat exchanger" in the claims, the indoor side heat exchanger temperature sensor 36-1 corresponds to the "first temperature determination unit," and the indoor side temperature sensor 38-1 corresponds to the "third temperature determination unit" in the claims. The indoor side heat exchangers 32-2 and 32-3 correspond to the "second heat exchanger" in the claims, the indoor side heat exchanger temperature sensors 36-2 and 36-3 correspond to the "second temperature determination unit," and the indoor side temperature sensors 38-2 and 38-3 correspond to the "fourth temperature determination unit" in the claims.

[0034] The rotational speed of the compressor 12 is, for example, 25% or less of the maximum rotational speed of the compressor 12. By suppressing the rotational speed of the compressor 12, it is possible to suppress the amount of refrigerant liquid returning to the accumulator 13 during the check operation, and it is possible to reduce the load applied to the compressor 12. The opening degree of the expansion valve 18-1 is, for example, 25% or less of the maximum flow opening degree of the expansion valve 18. By setting the opening degree of the expansion valve 18-1 to 25% or less, the decrease in the temperature of the indoor side heat exchanger 32 of the indoor unit 30-1 which is the determination target becomes gentle, and it is possible to suppress an increase in processing time.

[0035] Next, the outdoor side control unit 28 determines whether or not a temperature difference ΔT is equal to or higher than a temperature T_1 (step S152). The temperature difference ΔT is a difference between the temperature T_A detected by the indoor side temperature sensor 38-1 of the indoor unit 30-1 on which determination is to be performed and the temperature T_C detected by the indoor side heat exchanger temperature

sensor 36-1 of the indoor unit 30-1 on which determination is to be performed.

[0036] When the temperature difference ΔT is not equal to or higher than the temperature T_1 , the outdoor side control unit 28 determines whether or not a predetermined time has elapsed (step S154). When the predetermined time has not elapsed, the process of step S152 is repeated. When the predetermined time has elapsed, the outdoor side control unit 28 determines that there is a possibility that an abnormality may exist in the connection state of the pipe and the communication line of the indoor unit 30-1 on which determination is to be performed (step S166). This is because the temperature determined by the indoor side heat exchanger temperature sensor 36-1 has not decreased by more than a predetermined temperature even though the refrigerant is circulated in the indoor unit 30-1 on which determination is to be performed. In this case, the outdoor side control unit 28 and the communication line with the indoor side control unit 42 are misconnected, and there is a possibility that a difference may occur between the indoor side control unit 42 to be controlled and the indoor side control unit 42 that is actually controlled. In addition, the pipe between the indoor unit 30-1 and the outdoor unit 10 is erroneously connected, and there is a possibility that a difference may occur between the indoor unit 30-1 of the target through which the refrigerant is circulated and the indoor unit 30 in which the refrigerant is actually circulated.

[0037] When the temperature difference ΔT is equal to or higher than the temperature T_1 , the outdoor side control unit 28 determines whether or not the temperature difference ΔT_n is equal to or higher than the temperature T_2 for all the other indoor units 30 (step S156). The temperature difference ΔT_n is a difference between the temperature T_{An} detected by the indoor side temperature sensor 38 of the indoor unit 30 which is not the determination target for the connection state and the temperature T_{Cn} detected by the indoor side heat exchanger temperature sensor 36 of the indoor unit 30 which is not the determination target for the connection state. In the case in which there are a plurality of indoor units 30 which are not the determination targets, the outdoor side control unit 28 calculates the temperature difference ΔT_n between the temperature T_{An} detected by the indoor side temperature sensor 38 provided in each of the indoor units 30 which are not the determination targets and the temperature T_{Cn} detected by the indoor side heat exchanger temperature sensor 36 provided in each of the indoor units 30 which are not the determination targets. The outdoor side control unit 28 determines whether or not all the calculated temperature differences ΔT_n are equal to or higher than the temperature T_2 . When any one of the calculated temperature differences ΔT_n is equal to or higher than the temperature T_2 , the process proceeds to step S160. When all the calculated temperature differences ΔT_n are not equal to or higher than the temperature T_2 , the process proceeds to step S158.

[0038] When all the temperature differences ΔT_n are not equal to or higher than the temperature T_2 , the outdoor side control unit 28 determines that the indoor unit 30-1 is connected to the outdoor unit 10 normally (step S158). In this case, the outdoor side control unit 28 controls the compressor 12 to the OFF state (step S168). This is because since the temperature determined by the indoor side heat exchanger temperature sensor 36, which is not the determination target, is not lowered by the temperature T_2 or more, it is presumed that the refrigerant is not circulated in the indoor unit 30 that is not the determination target. For example, the temperature T_2 may be lower than the temperature T_1 .

[0039] When any one of the calculated temperature differences ΔT_n is equal to or higher than the temperature T_2 , the outdoor side control unit 28 waits until a predetermined time elapses (step S160). When the predetermined time has elapsed, the outdoor side control unit 28 determines whether or not the temperature TC is equal to or lower than the temperature TC_n (step S162). When there are a plurality of indoor units 30 which are not the determination targets, the outdoor side control unit 28 compares the temperature TC detected by the indoor side heat exchanger temperature sensor 36 of the indoor unit 30-1 on which determination is to be performed with the temperature TC_n detected by the indoor side heat exchanger temperature sensor 36 provided in each of the indoor units 30 which are not the determination target. If the temperature TC is equal to or lower than all the other temperatures TC_n , the process proceeds to step S164. If the temperature TC is not equal to or lower than one temperature of all the temperatures TC_n , the process proceeds to step S166.

[0040] When the temperature TC is not equal to or lower than the temperature TC_n , the outdoor side control unit 28 determines that there is a possibility that an abnormality may exist in the connection state of the pipe and the communication line of the indoor unit 30-1 on which determination is to be performed (step S166), and the process proceeds to S168. When the temperature TC is equal to or lower than the temperature TC_n , the outdoor side control unit 28 determines that the indoor unit 30-1 on which determination is to be performed is connected to the outdoor unit 10 normally (step S164), and controls the compressor 12 to a turned-off state (step S168). In this case, a temperature difference equal to or greater than the predetermined temperature occurs between the temperature of the indoor side temperature sensor 38 of the indoor unit 30 which is not the determination target and the temperature of the indoor side heat exchanger temperature sensor 36 of the indoor unit 30 which is not the determination target. However, since the temperature of the indoor side temperature sensor 38-1 of the indoor unit 30-1 on which determination is to be performed is lower than the temperature of the indoor side temperature sensor 38 of the other indoor unit 30, the refrigerant is presumed to circulate to the indoor unit 30-1 on which determination is to be performed. As a

result, the processing of this flowchart ends.

[0041] When the determining process of one indoor unit 30-1 is completed as described above, for example, the determining process of the next indoor unit 30-2 is executed. In the determining process of the next indoor unit 30-2, the indoor unit 30-1, which is determined to be connected to the outdoor unit 10 normally, is excluded from the comparison target in the determining process. For example, in the process of determining whether or not the temperature difference ΔT_n in step S156 is equal to or higher than the temperature T_2 and in the process of determining whether or not the temperature TC in step S162 is equal to or lower than the temperature TC_n , the indoor unit 30-1 determined to be normally connected to the outdoor unit 10 is excluded from comparison. On the other hand, if it is determined that there is a possibility that an abnormality may exist in the connection state of the pipe and the communication line between the outdoor unit 10 and the indoor unit 30-1, the indoor unit 30-1 is included in the comparison targets, in the process of determining that the temperature difference ΔT_n in step S156 is equal to or higher than the temperature T_2 and the process of determining whether or not the temperature TC in step S162 is equal to or lower than the temperature TC_n .

[0042] Further, when the determining process of the connection state is executed for all the indoor units 30, and the check operation is completed, the outdoor side control unit 28 displays the results of the check operation on the display unit of the outdoor side operation unit 26. For example, information indicating the presence or absence of the indoor units 30 that may not be connected to the outdoor unit 10 normally is displayed on the display unit of the outdoor side operation unit 26. Further, identification information of the indoor unit 30 that is not connected to the outdoor unit 10 normally is displayed on the display unit of the outdoor side operation unit 26.

[0043] Meanwhile, there is a case where it is determined whether the connection of the pipe and the signal line between the indoor unit and the outdoor unit is normal on the basis of the temperature change of the indoor side heat exchanger. In this case, due to the influence of the refrigerant remaining in the indoor side heat exchanger, the temperature of the indoor side heat exchanger through which the refrigerant does not flow may also change, and there is a case in which it is not possible to more accurately determine whether the connection of the pipe and the communication line between the outdoor unit 10 and the indoor unit 30 is normal.

[0044] In contrast, in the air conditioning system 1 of the present embodiment, even if there is a residual refrigerant by the above-described determining process and there is a temperature change in the indoor unit 30 and the air conditioning target space different from the target of the determining process, it is possible to more accurately determine whether the connection of the pipe and the communication line between the outdoor unit 10 and the indoor unit 30 is normal. Furthermore, in the air

conditioning system 1 of the present embodiment, since the determining process is performed in a state in which the temperature of the indoor side heat exchanger 32 of the indoor unit 30 is maintained at a predetermined level or higher, it is possible to more accurately determine whether the connection of the pipe and the communication line between the outdoor unit 10 and the indoor unit 30 is normal.

[0045] According to the first embodiment described above, the outdoor side control unit 28 determines that the connection state of the refrigerant pipe or the communication line connected to the indoor unit 30 which is the determination target is normal, when the temperature difference ΔT of the indoor unit 30, which is the determination target for the connection state, is equal to or higher than the temperature T_1 , and the temperature difference ΔT_n of the indoor side control unit 30 which is not the determination target is not equal to or higher than the temperature T_2 . Further, even when the temperature difference ΔT_n of the indoor unit 30, which is not the determination target for the connection state, is equal to or higher than the temperature T_2 , the outdoor side control unit 28 determines that the connection state of the refrigerant pipe or the communication line connected to the indoor unit 30 on which determination is to be performed is normal, when the temperature T_C is equal to or lower than the temperature T_{Cn} after a lapse of a predetermined time. As a result, the air conditioning system 1 can more accurately determine whether the connection of the pipe or the communication line between the outdoor unit 10 and the indoor unit 30 is normal.

(Second embodiment)

[0046] A second embodiment will be described below. Here, differences from the first embodiment will be mainly described, and the description of the functions and the like common with the first embodiment will be omitted. In the first embodiment, in the interval time, the fan 34 is maintained in the ON state and all the expansion valves 18 are controlled to the open state. In contrast, in the second embodiment, in the interval time, the fan 34 is maintained in the OFF state, the expansion valve 18 for circulating the refrigerant to the indoor unit 30 subject to the determining process is controlled to the open state, and the other expansion valve 18 is controlled to the closed state. Hereinafter, differences from the first embodiment will be mainly described.

[0047] Fig. 6 is a flowchart showing the flow of processing executed by the outdoor side control unit 28 of the second embodiment. First, the outdoor side control unit 28 selects an indoor unit 30, in which the determination of the connection state has not been completed, among the plurality of indoor units 30 (step S200).

[0048] The outdoor side control unit 28 controls the expansion valve 18 of the indoor unit 30 selected in step S200 to the open state (step S202). The outdoor side control unit 28 controls the air conditioning system 1 to

a standby state for a predetermined time (step S204). Next, the outdoor side control unit 28 executes a determining process of the connection state (step S206). Since the determining process is the same as the processes from the steps S150 to S168 described in the first embodiment, a description thereof will be omitted.

[0049] Next, the outdoor side control unit 28 determines whether or not the connection state of all the indoor units 30 has been determined (step S208). If the connection state of all the indoor units 30 has not been determined, the process returns to step S200. When the connection state of all the indoor units 30 has been determined, the process of this flowchart ends. As a result, the processing executed by this flowchart ends.

[0050] Fig. 7 is a diagram showing an overview of the check operation performed by the outdoor side control unit 28 according to the second embodiment. For example, the indoor unit 30-1 having the room A as an air conditioning target space, the indoor unit 30-2 having the room B as an air conditioning target space, and the indoor unit 30-3 having the room C as an air conditioning target will be described as being subjected to the check operation. Also, it is assumed that the determining process is executed one by one in order from room A to room C.

[0051] First, the outdoor side control unit 28 controls the compressor 12 to the ON state, and controls the expansion valve 18-1 for circulating the refrigerant in the indoor unit 30-1 to the predetermined open state. When the determining process of the room A is completed, the outdoor side control unit 28 sets the compressor 12 to the OFF state, controls the expansion valve 18 of the indoor unit 30-2 of the next determination target to the predetermined open state and controls the other expansion valve 18 to the closed state. After the lapse of the interval time, the determining process of the room B is executed, and after the lapse of the interval time, the determining process of the room C is executed. In the second embodiment, the fan 34 is controlled to the OFF state during the interval time. Thus, it is possible to execute the check operation, without making the user in the room subjected to the determining process feel that the check operation is performed.

[0052] According to the second embodiment described above, in order to maintain the fan 34 in the OFF state in the interval time, the outdoor side control unit 28 can perform the check operation, without making the person in the air conditioning target space feel that the check operation is performed. In addition, the outdoor side control unit 28 controls the expansion valve 18 for circulating the refrigerant to the indoor unit 30, which is the target of the determining process, to the open state, and controls the other expansion valve 18 to the closed state, thereby making it possible to execute the next determining process in a state in which the influence of the refrigerant remaining in the refrigerant pipe is reduced.

[0053] In the air conditioning system 1 according to the first embodiment and the second embodiment, the determining process at the time of the cooling operation

has been described, but the first embodiment and the second embodiment are also applied at the time of the heating operation. In this case, the outdoor side control unit 28 determines whether the temperature difference ΔT is equal to or lower than the temperature T_1 ($\Delta T \leq T_1$) in step S152 of the determining process. Further, the outdoor side control unit 28 determines whether the temperature difference ΔT_n is equal to or lower than the temperature T_2 ($\Delta T_n \leq T_2$) in step S 156 of the determining process. Further, the outdoor side control unit 28 determines whether the temperature TC is equal to or higher than the temperature TC_n ($TC \geq TC_n$) in step S 162 of the determining process.

[0054] In addition, in the air conditioning system 1 according to the first embodiment and the second embodiment, the description has been given of a case where the outdoor side control unit 28 performs the determination of step S152 (determination as to whether the temperature difference ΔT is equal to or higher than the temperature T_1), the determination of step S 156 (determination as to whether the temperature difference ΔT_n is equal to or higher than the temperature T_2 for all the other indoor units 30), and the determination of step S162 (determination as to whether the temperature TC is equal to or lower than the temperature TC_n). However, the outdoor side control unit 28 may acquire one or more determination results from the above-described respective steps from another device, and determine whether at least one of the pipe and the communication line is correctly connected on the basis of the acquired determination result. In this case, the other device acquires the detection result of the indoor side heat exchanger temperature sensor 36 included in the indoor unit 30 and the detection result of the indoor side temperature sensor 38, performs one or more determinations among the respective steps on the basis of the acquired detection results, and transmits the determination result to the outdoor side control unit 28 via a network such as a local area network (LAN).

[0055] According to at least one embodiment described above, by including an outdoor unit having at least a compressor and connectable to a refrigerant pipe system, a first indoor unit having a first heat exchanger and connectable to the refrigerant pipe system, a second indoor unit having a second heat exchanger and connectable to the refrigerant pipe system, a first temperature determination unit which is configured to determine the temperature of the first heat exchanger, a second temperature determination unit which is configured to determine the temperature of the second heat exchanger, a third temperature determination unit provided for the first indoor unit and configured to determine the temperature of an air conditioning target space associated with the first indoor unit, a fourth temperature determination unit provided for the second indoor unit and configured to determine the temperature of an air conditioning target space associated with the second indoor unit, and a control unit configured to determine whether at least one of

a first refrigerant pipe connected to the first indoor unit of the refrigerant pipe system connected to the first indoor unit and a first communication line connected to the first indoor unit is correctly connected, when a first temperature difference between the temperature determined by the first temperature determination unit and the temperature determined by the third temperature determination unit is equal to or higher than a first threshold value, and a second temperature difference between the temperature determined by the second temperature determination unit and the temperature determined by the fourth temperature determination unit is less than a second threshold value, it is possible to determine whether the pipe or the connection pipe is correctly connected.

Claims

1. An air conditioning system, comprising:

an outdoor unit (10) having at least a compressor (12) and connectable to a plurality of connection pipes (2-1-1, 2-1-2, ..., 2-n-2);
 a first indoor unit (30-1) having a first heat exchanger (32-1) and connectable to a first connection pipe (2-1-1, 2-1-2) in the plurality of connection pipes (2-1-1, 2-1-2, ..., 2-n-2);
 a second indoor unit (30-2, ..., 30-n) having a second heat exchanger (32-2, ..., 32-n) and connectable to a second connection pipe (2-2-1, 2-2-2, ..., 2-n-2) in the plurality of connection pipes (2-1-1, 2-1-2, ..., 2-n-2);
 a first expansion valve (18-1) provided between the compressor (12) and the first heat exchanger (32-1) and configured to control a flow rate of a refrigerant, the refrigerant being flowing to the first heat exchanger (32-1) and being discharging from the compressor (12);
 a second expansion valve (18-2, ..., 18-n) provided between the compressor (12) and the second heat exchanger (32-2, ..., 32-n) and configured to control a flow rate of a refrigerant, the refrigerant being flowing to the second heat exchanger (32-2, ..., 32-n) and being discharging from the compressor (12);
 wherein the first indoor unit (30-1) includes a first blower fan (34-1) that is configured to blow air having undergone heat exchange via the first heat exchanger (32-1) to an air conditioning target space associated with the first indoor unit (30-1), and
 the second indoor unit (30-2, ..., 30-n) includes a second blower fan (34-2, ..., 34-n) that is configured to blow air having undergone heat exchange via the second heat exchanger (32-2, ..., 32-n) to an air conditioning target space associated with the second indoor unit (30-2, ..., 30-n);

a first temperature determination unit (36-1) configured to determine the temperature of the first heat exchanger (32-1);
 a second temperature determination unit (36-2, ..., 36-n) configured to determine the temperature of the second heat exchanger (32-2, ..., 32-n);
 a third temperature determination unit (38-1) provided for the first indoor unit (30-1) and configured to determine the temperature of the air conditioning target space associated with the first indoor unit (30-1);
 a fourth temperature determination unit (38-2, ..., 38-n) provided for the second indoor unit (30-2, ..., 30-n) and configured to determine the temperature of the air conditioning target space associated with the second indoor unit (30-2, ..., 30-n);
 a control unit having an outdoor side control unit (28) for controlling a driving of the compressor (12), and a first and a second indoor side control unit (42) for the first indoor unit (30-1) and the second indoor unit (30-2, ..., 30-n), respectively; wherein the outdoor side control unit (28) and each of the first and second indoor side control unit (42) are connected through a communication line and an electrical line; and
 a first and a second communication line, for respectively connecting the outdoor side control unit (28) to the first and second indoor side control unit (42);
 wherein the control unit is configured to determine a connection state for each of the first indoor unit (30-1) and the second indoor unit (30-2, ..., 30-n) to determine whether or not the connection pipes (2-1-1, 2-1-2, ..., 2-n-2) and the communication lines are correctly connected, comprising:

wherein the outdoor side control unit (28) is configured to determine a connection state for the first indoor unit (30-1);
 the outdoor side control unit (28) is configured to control the first blower fan (34-1) in an ON state (S102), and control the first and second expansion valve (18-1, 18-2, ..., 18-n) of the first and second indoor units (30-1, 30-2, ..., 30-n) in an open state (S104);
 the outdoor side control unit (28) is configured to control the air conditioning system in a standby state for a predetermined time (S106);
 the outdoor side control unit (28) is configured to execute a determining process for determining whether or not the connection pipes (2-1-1, 2-1-2, ..., 2-n-2) and the communication lines are correctly connected (S108);

wherein the determining process comprises:

wherein the outdoor side control unit (28) is configured to determine a connected state for the first indoor unit (30-1);
 the outdoor side control unit (28) is configured to control the compressor (12) in an ON state and the first expansion valve (18-1) in a predetermined open state (S150),
 the control unit is configured to determine whether at least one of the first connection pipe (2-1-1, 2-1-2) and the first communication line connected to the first indoor unit (30-1) is correctly connected,
 when a first temperature difference (ΔT) between the temperature determined by the first temperature determination unit (36-1) and the temperature determined by the third temperature determination unit (38-1) is equal to or higher than a first threshold value (T_1), and a second temperature difference (ΔT_n) between the temperature determined by the second temperature determination unit (36-2, ..., 36-n) and the temperature determined by the fourth temperature determination unit (38-2, ..., 38-n) is less than a second threshold value, it is determined that the at least one of the first connection pipe (2-1-1, 2-1-2) and the first communication line connected to the first indoor unit (30-1) is correctly connected (S152, S156, S158);
 the outdoor side control unit (28) is configured to control the compressor (12) in an OFF state (S168), and control the first expansion valve (18-1) in an open state and the second expansion valve (18-2, ..., 18-n) in an open state during an interval time, determine a connected state for the second indoor unit (30-2, ..., 30-n) after the interval time is elapsed.

2. The air conditioning system according to claim 1,

wherein the control unit is configured to determine whether the first temperature difference (ΔT) between the temperature determined by the first temperature determination unit (36-1) and the temperature determined by the third temperature determination unit (38-1) is equal to or higher than the first threshold value (T_1), and
 is configured to determine whether the second temperature difference (ΔT_n) between the temperature (T_2) determined by the second temperature determination unit (36-2, ..., 36-n) and the temperature determined by the fourth temperature determination unit (38-2, ..., 38-n) is less

than the second threshold value (S152, S156).

3. The air conditioning system according to claim 1,

wherein the outdoor side control unit (28) is configured to determine whether or not the connection state for each of the first indoor unit (30-1) and the second indoor unit (30-2, ..., 30-n) has been determined (S110);
if not, the outdoor side control unit (28) is configured to select an indoor unit, which the determination of its connection state has not been completed, among the first indoor unit (30-1) and the second indoor unit (30-2, ..., 30-n), and determine its connection state.

4. The air conditioning system according to claim 1,

wherein, when the first temperature difference (ΔT) is equal to or higher than the first threshold value (T1) and the second temperature difference (ΔT_n) is equal to or higher than the second threshold value (T2), after the lapse of a predetermined time from the determination (S156), when the temperature (TC) determined by the first temperature determination unit (36-1) provided corresponding to the first indoor unit (30-1) is equal to or less than the temperature (TC_n) determined by the second temperature determination unit (36-2, ..., 36-n) provided corresponding to the second indoor unit (30-2, ..., 30-n), the control unit is configured to determine that the first connection pipe (2-1-1, 2-1-2) and the first communication line is correctly connected (S162, S164).

5. The air conditioning system according to claim 1, further comprising:

a third indoor unit (32-3) having a third heat exchanger (32-3) and connectable to a plurality of connection pipes (2-1-1, 2-1-2, ..., 2-n-2);
a fifth temperature determination unit (36-3) configured to determine the temperature of the third heat exchanger (32-3); and
a sixth temperature determination unit (38-3) provided for the third indoor unit (30-3) and configured to determine the temperature of an air conditioning target space associated with the third indoor unit (30-3),
wherein, when it is determined that the first connection pipe (2-1-1, 2-1-2) and the first communication line connected to the first indoor unit (30-1) is correctly connected,
in a case where a third temperature difference (ΔT) between the temperature determined by the second temperature determination unit (36-2) and the temperature determined by the

fourth temperature determination unit (38-2) is equal to or higher than the first threshold value (T1), and a fourth temperature difference (ΔT_n) between the temperature determined by the fifth temperature determination unit (36-3) and the temperature determined by the sixth temperature determination unit (38-3) is less than the second threshold value (T2), the control unit is configured to determine that the second connection pipe (2-2-1, 2-2-2) connected to the second indoor unit (30-2) and a second communication line connected to the second indoor unit (30-2) is correctly connected.

6. The air conditioning system according to claim 1, wherein, when it is determined that the first connection pipe (2-1-1, 2-1-2) and the first communication line connected to the first indoor unit (30-1) is correctly connected, the control unit does not use the temperature determined by the first temperature determination unit (36-1) and the temperature determined by the third temperature determination unit (38-1), when determining whether the second connection pipe (2-2-1, 2-2-2) connected to the second indoor unit (30-2) and the second communication line connected to the second indoor unit (30-2) is correctly connected.

7. The air conditioning system according to claim 1, wherein the control unit is configured to control at least the second blower fan (34-2, ..., 34-n) to an ON state, for the interval time after determining the connection state of the first indoor unit (30-1).

Patentansprüche

1. Klimatisierungssystem, umfassend:

eine Außeneinheit (10), die mindestens einen Verdichter (12) aufweist und mit mehreren Anschlussrohren (2-1-1, 2-1-2, ..., 2-n-2) verbindbar ist;
eine erste Inneneinheit (30-1), die einen ersten Wärmetauscher (32-1) aufweist und mit einem ersten Anschlussrohr (2-1-1, 2-1-2) der mehreren Anschlussrohre (2-1-1, 2-1-2, ..., 2-n-2) verbindbar ist;
eine zweite Inneneinheit (30-2, ..., 30-n), die einen zweiten Wärmetauscher (32-2, ..., 32-n) aufweist und mit einem zweiten Anschlussrohr (2-2-1, 2-2-2, ..., 2-n-2) der mehreren Anschlussrohre (2-1-1, 2-1-2, ..., 2-n-2) verbindbar ist;
ein erstes Expansionsventil (18-1), das zwischen dem Verdichter (12) und dem ersten Wärmetauscher (32-1) bereitgestellt ist und dafür ausgelegt ist, eine Durchflussrate eines Kälte-

mittels zu steuern, wobei das Kältemittel in den ersten Wärmetauscher (32-1) einströmt und aus dem Verdichter (12) ausströmt;

ein zweites Expansionsventil (18-2, ..., 18-n), das zwischen dem Verdichter (12) und dem zweiten Wärmetauscher (32-2, ..., 32-n) bereitgestellt ist und dafür ausgelegt ist, eine Durchflussrate eines Kältemittels zu steuern, wobei das Kältemittel in den zweiten Wärmetauscher (32-2, ..., 32-n) einströmt und aus dem Verdichter (12) ausströmt;

wobei die erste Inneneinheit (30-1) einen ersten Gebläseventilator (34-1) beinhaltet, der dafür ausgelegt ist, Luft, die einem Wärmeaustausch über den ersten Wärmetauscher (32-1) unterzogen wurde, in einen Klimatisierungszielraum zu blasen, der der ersten Inneneinheit (30-1) zugeordnet ist, und

die zweite Inneneinheit (30-2, ..., 30-n) einen zweiten Gebläseventilator (34-2, ..., 34-n) beinhaltet, der dafür ausgelegt ist, Luft, die einem Wärmeaustausch über den zweiten Wärmetauscher (32-2, ..., 32-n) unterzogen wurde, in einen Klimatisierungszielraum zu blasen, der der zweiten Inneneinheit (30-2, ..., 30-n) zugeordnet ist;

eine erste Temperaturbestimmungseinheit (36-1), die dafür ausgelegt ist, die Temperatur des ersten Wärmetauschers (32-1) zu bestimmen;

eine zweite Temperaturbestimmungseinheit (36-2, ..., 36-n), die dafür ausgelegt ist, die Temperatur des zweiten Wärmetauschers (32-2, ..., 32-n) zu bestimmen;

eine dritte Temperaturbestimmungseinheit (38-1), die für die erste Inneneinheit (30-1) bereitgestellt ist und dafür ausgelegt ist, die Temperatur des Klimatisierungszielraums, der der ersten Inneneinheit (30-1) zugeordnet ist, zu bestimmen;

eine vierte Temperaturbestimmungseinheit (38-2, ..., 38-n), die für die zweite Inneneinheit (30-2, ..., 30-n) bereitgestellt ist und dafür ausgelegt ist, die Temperatur des Klimatisierungszielraums, der der zweiten Inneneinheit (30-2, ..., 30-n) zugeordnet ist, zu bestimmen;

eine Steuereinheit, die eine außenseitige Steuereinheit (28) zum Steuern eines Antriebs des ersten Verdichters (12) und jeweils eine erste und eine zweite innenseitige Steuereinheit (42) für die erste Inneneinheit (30-1) und die zweite Inneneinheit (30-2, ..., 30-n) aufweist; wobei die außenseitige Steuereinheit (28) und jede von der ersten und der zweiten innenseitigen Steuereinheit (42) durch eine Kommunikationsleitung und eine elektrische Leitung verbunden sind; und

eine erste und eine zweite Kommunikationslei-

tung zum jeweiligen Verbinden der außenseitigen Steuereinheit (28) mit der ersten und der zweiten innenseitigen Steuereinheit (42); wobei die Steuereinheit dafür ausgelegt ist, einen Verbindungszustand für jede von der ersten Inneneinheit (30-1) und der zweiten Inneneinheit (30-2, ..., 30-n) zu bestimmen, um zu bestimmen, ob die Anschlussrohre (2-1-1, 2-1-2, ..., 2-n-2) und die Kommunikationsleitungen ordnungsgemäß verbunden sind oder nicht, umfassend:

wobei die außenseitige Steuereinheit (28) dafür ausgelegt ist, einen Verbindungszustand für die erste Inneneinheit (30-1) zu bestimmen;

die außenseitige Steuereinheit (28) dafür ausgelegt ist, den ersten Gebläseventilator (34-1) in einen EIN-Zustand zu bringen (S102) und das erste und das zweite Expansionsventil (18-1, 18-2, ..., 18-n) der ersten und der zweiten Inneneinheit (30-1, 30-2, ..., 30-n) in einen geöffneten Zustand zu bringen (S104);

die außenseitige Steuereinheit (28) dafür ausgelegt ist, das Klimatisierungssystem für eine vorbestimmte Zeit in einen Bereitschaftszustand zu bringen (S106);

die außenseitige Steuereinheit (28) dafür ausgelegt ist, einen Bestimmungsprozess zum Bestimmen, ob die Anschlussrohre (2-1-1, 2-1-2, ..., 2-n-2) und die Kommunikationsleitungen ordnungsgemäß verbunden sind oder nicht, auszuführen (S108); wobei der Bestimmungsprozess Folgendes umfasst:

wobei die außenseitige Steuereinheit (28) dafür ausgelegt ist, einen Verbindungszustand für die erste Inneneinheit (30-1) zu bestimmen;

die außenseitige Steuereinheit (28) dafür ausgelegt ist, den Verdichter (12) in einen EIN-Zustand und das erste Expansionsventil (18-1) in einen vorbestimmten geöffneten Zustand zu bringen (S150),

die Steuereinheit dafür ausgelegt ist, zu bestimmen, ob zumindest eines von dem ersten Anschlussrohr (2-1-1, 2-1-2) und der ersten Kommunikationsleitung, welche mit der ersten Inneneinheit (30-1) verbunden sind, ordnungsgemäß verbunden ist,

wenn eine erste Temperaturdifferenz (ΔT) zwischen der von der ersten Temperaturbestimmungseinheit (36-1) bestimmten Temperatur und der von der

dritten Temperaturbestimmungseinheit (38-1) bestimmten Temperatur gleich oder größer als ein erster Schwellenwert (T1) ist, und eine zweite Temperaturdifferenz (ΔT_n) zwischen der von der zweiten Temperaturbestimmungseinheit (36-2, ..., 36-n) bestimmten Temperatur und der von der vierten Temperaturbestimmungseinheit (38-2, ..., 38-n) bestimmten Temperatur kleiner als ein zweiter Schwellenwert ist, bestimmt wird, dass das zumindest eine von dem ersten Anschlussrohr (2-1-1, 2-1-2) und der ersten Kommunikationsleitung, welche mit der ersten Inneneinheit (30-1) verbunden sind, ordnungsgemäß verbunden ist (S152, S156, S158);
 die außenseitige Steuereinheit (28) dafür ausgelegt ist, den Verdichter (12) in einen AUS-Zustand zu bringen (S168) und das erste Expansionsventil (18-1) in einen geöffneten Zustand und das zweite Expansionsventil (18-2, ..., 18-n) während einer Intervallzeit in einen geöffneten Zustand zu bringen, einen Verbindungszustand für die zweite Inneneinheit (30-2, ..., 30-n) zu bestimmen, nachdem die Intervallzeit abgelaufen ist.

2. Klimatisierungssystem nach Anspruch 1,

wobei die Steuereinheit dafür ausgelegt ist, zu bestimmen, ob die erste Temperaturdifferenz (ΔT) zwischen der von der ersten Temperaturbestimmungseinheit (36-1) bestimmten Temperatur und der von der dritten Temperaturbestimmungseinheit (38-1) bestimmten Temperatur gleich oder größer als der erste Schwellenwert (T1) ist, und dafür ausgelegt ist, zu bestimmen, ob die zweite Temperaturdifferenz (ΔT_n) zwischen der von der zweiten Temperaturbestimmungseinheit (36-2, ..., 36-n) bestimmten Temperatur (T2) und der von der vierten Temperaturbestimmungseinheit (38-2, ..., 38-n) bestimmten Temperatur kleiner als der zweite Schwellenwert ist (S152, S156).

3. Klimatisierungssystem nach Anspruch 1,

wobei die außenseitige Steuereinheit (28) dafür ausgelegt ist, zu bestimmen, ob der Verbindungszustand für jede von der ersten Inneneinheit (30-1) und der zweiten Inneneinheit (30-2, ..., 30-n) bestimmt wurde oder nicht (S110);

falls nicht, die außenseitige Steuereinheit (28) dafür ausgelegt ist, eine Inneneinheit, bei der die Bestimmung ihres Verbindungszustands nicht abgeschlossen wurde, aus der ersten Inneneinheit (30-1) und der zweiten Inneneinheit (30-2, ..., 30-n) auszuwählen und ihren Verbindungszustand zu bestimmen.

4. Klimatisierungssystem nach Anspruch 1,

wobei, wenn, nach dem Ablauf einer vorbestimmten Zeit ab der Bestimmung (S156), die erste Temperaturdifferenz (ΔT) gleich oder größer als der erste Schwellenwert (T1) ist und die zweite Temperaturdifferenz (ΔT_n) gleich oder größer als der zweite Schwellenwert (T2) ist, wenn die von der entsprechend der ersten Inneneinheit (30-1) bereitgestellten ersten Temperaturbestimmungseinheit (36-1) bestimmte Temperatur (TC) gleich oder niedriger als die von der entsprechend der zweiten Inneneinheit (30-2, ..., 30-n) bereitgestellten Temperaturbestimmungseinheit (36-2, ..., 36-n) bestimmte Temperatur (TCn) ist, die Steuereinheit dafür ausgelegt ist, zu bestimmen, dass das erste Anschlussrohr (2-1-1, 2-1-2) und die erste Kommunikationsleitung ordnungsgemäß verbunden ist (S162, S164).

5. Klimatisierungssystem nach Anspruch 1, ferner umfassend:

eine dritte Inneneinheit (32-3), die einen dritten Wärmetauscher (32-3) aufweist und mit mehreren Anschlussrohren (2-1-1, 2-1-2, ..., 2-n-2) verbindbar ist;

eine fünfte Temperaturbestimmungseinheit (36-3), die dafür ausgelegt ist, die Temperatur des dritten Wärmetauschers (32-3) zu bestimmen; und

eine sechste Temperaturbestimmungseinheit (38-3), die für die dritte Inneneinheit (30-3) bereitgestellt ist und dafür ausgelegt ist, die Temperatur eines Klimatisierungszielraums, der der dritten Inneneinheit (30-3) zugeordnet ist, zu bestimmen,

wobei, wenn bestimmt wird, dass das erste Anschlussrohr (2-1-1, 2-1-2) und die erste Kommunikationsleitung, welche mit der ersten Inneneinheit (30-1) verbunden sind, ordnungsgemäß verbunden ist,

in einem Fall, in dem eine dritte Temperaturdifferenz (ΔT) zwischen der von der zweiten Temperaturbestimmungseinheit (36-2) bestimmten Temperatur und der von der vierten Temperaturbestimmungseinheit (38-2) bestimmten Temperatur gleich oder größer als der erste Schwellenwert (T1) ist, und eine vierte Temperaturdif-

- ferenz (ΔT_n) zwischen der von der fünften Temperaturbestimmungseinheit (36-3) bestimmten Temperatur und der von der sechsten Temperaturbestimmungseinheit (38-3) bestimmten Temperatur kleiner als der zweite Schwellenwert (T_2) est, die Steuereinheit dafür ausgelegt ist, zu bestimmen, dass das zweite Anschlussrohr (2-2-1, 2-2-2), das mit der zweiten Inneneinheit (30-2) verbunden ist, und eine zweite Kommunikationsleitung, die mit der zweiten Inneneinheit (30-2) verbunden ist, ordnungsgemäß verbunden ist.
6. Klimatisierungssystem nach Anspruch 1, wobei, wenn bestimmt wird, dass das erste Anschlussrohr (2-1-1, 2-1-2) und die erste Kommunikationsleitung, welche mit der ersten Inneneinheit (30-1) verbunden sind, ordnungsgemäß verbunden ist, die Steuereinheit, beim Bestimmen, ob das zweite Anschlussrohr (2-2-1, 2-2-2), das mit der zweiten Inneneinheit (30-2) verbunden ist, und die zweite Kommunikationsleitung, die mit der zweiten Inneneinheit (30-2) verbunden ist, ordnungsgemäß verbunden ist, die von der ersten Temperaturbestimmungseinheit (36-1) bestimmte Temperatur und die von der dritten Temperaturbestimmungseinheit (38-1) bestimmte Temperatur nicht verwendet.
7. Klimatisierungssystem nach Anspruch 1, wobei die Steuereinheit dafür ausgelegt ist, zumindest den zweiten Gebläseventilator (34-2, ..., 34-n) für die Intervallzeit nach Bestimmen des Verbindungszustands der ersten Inneneinheit (30-1) in einen EIN-Zustand zu bringen.

Revendications

1. Système de conditionnement d'air, comprenant :
- une unité extérieure (10) ayant au moins un compresseur (12) et pouvant être raccordée à une pluralité de tuyaux de raccordement (2-1-1, 2-1-2, ..., 2-n-2) ;
 - une première unité intérieure (30-1) ayant un premier échangeur de chaleur (32-1) et pouvant être raccordée à un premier tuyau de raccordement (2-1-1, 2-1-2) dans la pluralité de tuyaux de raccordement (2-1-1, 2-1-2, ..., 2-n-2) ;
 - une deuxième unité intérieure (30-2, ..., 30-n) ayant un deuxième échangeur de chaleur (32-2, ..., 32-n) et pouvant être raccordée à un deuxième tuyau de raccordement (2-2-1, 2-2-2, ..., 2-n-2) dans la pluralité de tuyaux de raccordement (2-1-1, 2-1-2, ..., 2-n-2) ;
 - une première soupape de détente (18-1) disposée entre le compresseur (12) et le premier échangeur de chaleur (32-1) et configurée pour

contrôler un débit d'un réfrigérant, le réfrigérant s'écoulant vers le premier échangeur de chaleur (32-1) et s'évacuant du compresseur (12) ;

une deuxième soupape de détente (18-2, ..., 18-n) prévue entre le compresseur (12) et le deuxième échangeur de chaleur (32-2, ..., 32-n) et configurée pour contrôler un débit d'un réfrigérant, le réfrigérant s'écoulant vers le deuxième échangeur de chaleur (32-2, ..., 32-n) et s'évacuant du compresseur (12) ;

dans lequel la première unité intérieure (30-1) comprend un premier ventilateur soufflant (34-1) qui est configuré pour souffler de l'air ayant subi un échange de chaleur via le premier échangeur de chaleur (32-1) vers un espace cible de conditionnement d'air associé à la première unité intérieure (30-1) et

la deuxième unité intérieure (30-2, ..., 30-n) comprend un deuxième ventilateur soufflant (34-2, ..., 34-n) qui est configuré pour souffler de l'air ayant subi un échange de chaleur via le deuxième échangeur de chaleur (32-2, ..., 32-n) vers un espace cible de conditionnement d'air associé à la deuxième unité intérieure (30-2, ..., 30-n) ;

une première unité de détermination de température (36-1) configurée pour déterminer la température du premier échangeur de chaleur (32-1) ;

une deuxième unité de détermination de température (36-2, ..., 36-n) configurée pour déterminer la température du deuxième échangeur de chaleur (32-2, ..., 32-n) ;

une troisième unité de détermination de température (38-1) prévue pour la première unité intérieure (30-1) et configurée pour déterminer la température de l'espace cible de conditionnement d'air associé à la première unité intérieure (30-1) ;

une quatrième unité de détermination de température (38-2, ..., 38-n) prévue pour la deuxième unité intérieure (30-2, ..., 30-n) et configurée pour déterminer la température de l'espace cible de conditionnement d'air associé à la deuxième unité intérieure (30-2, ..., 30-n) ;

une unité de commande ayant une unité de commande côté extérieur (28) pour commander un entraînement du compresseur (12), et une première et une deuxième unité de commande côté intérieur (42) pour la première unité intérieure (30-1) et la deuxième unité intérieure (30-2, ..., 30-n), respectivement ;

dans lequel l'unité de commande côté extérieur (28) et chacune des première et deuxième unités de commande côté intérieur (42) sont raccordées via une ligne de communication et une ligne électrique ; et

une première et une deuxième lignes de com-

munication, pour connecter respectivement l'unité de commande côté extérieur (28) à la première et à la deuxième unité de commande côté intérieur (42) ;

dans lequel l'unité de commande est configurée pour déterminer un état de connexion pour chacune de la première unité intérieure (30-1) et la deuxième unité intérieure (30-2, ..., 30-n) pour déterminer si oui ou non les tuyaux de raccordement (2-1-1, 2-1-2, ..., 2-n-2) et les lignes de communication sont correctement raccordés, comprenant :

dans lequel l'unité de commande côté extérieur (28) est configurée pour déterminer un état de connexion pour la première unité intérieure (30-1);

l'unité de commande côté extérieur (28) est configurée pour commander le premier ventilateur soufflant (34-1) dans un état MARCHE (S102), et commander la première et la deuxième soupape de détente (18-1, 18-2, ..., 18-n) des première et deuxième unités intérieures (30-1, 30-2, ..., 30-n) dans un état ouvert (S104);

l'unité de commande côté extérieur (28) est configurée pour commander le système de conditionnement d'air dans un état de veille pendant un temps prédéterminé (S106);

l'unité de commande côté extérieur (28) est configurée pour exécuter un processus de détermination pour déterminer si oui ou non les tuyaux de raccordement (2-1-1, 2-1-2, ..., 2-n-2) et les lignes de communication sont correctement raccordés (S108) ;

dans lequel le processus de détermination comprend :

dans lequel l'unité de commande côté extérieur (28) est configurée pour déterminer un état connecté pour la première unité intérieure (30-1);

l'unité de commande côté extérieur (28) est configurée pour commander le compresseur (12) dans un état MARCHE et la première soupape de détente (18-1) dans un état ouvert prédéterminé (S150),

l'unité de commande est configurée pour déterminer si au moins un du premier tuyau de raccordement (2-1-1, 2-1-2) et la première ligne de communication raccordée à la première unité intérieure (30-1) est correctement raccordé,

lorsqu'un premier écart de température (ΔT) entre la température déterminée

par la première unité de détermination de température (36-1) et la température déterminée par la troisième unité de détermination de température (38-1) est égale ou supérieure à une première valeur de seuil (T1) et une deuxième différence de température (ΔT_n) entre la température déterminée par la deuxième unité de détermination de température (36-2, ..., 36-n) et la température déterminée par la quatrième unité de détermination de température (38-2, ..., 38-n) est inférieure à une deuxième valeur de seuil, il est déterminé qu'au moins un parmi le premier tuyau de raccordement (2-1-1, 2-1-2) et la première ligne de communication raccordée à la première unité intérieure (30-1) est correctement raccordée (S152, S156, S158) ;

l'unité de commande côté extérieur (28) est configurée pour commander le compresseur (12) dans un état ARRET (S168), et commander la première soupape de détente (18-1) dans un état ouvert et la deuxième soupape de détente (18-2, ..., 18-n) dans un état ouvert pendant un intervalle de temps, déterminer un état connecté pour la deuxième unité intérieure (30-2, ..., 30-n) après que l'intervalle de temps s'est écoulé.

2. Système de conditionnement d'air selon la revendication 1,

dans lequel l'unité de commande est configurée pour déterminer si la première différence de température (ΔT) entre la température déterminée par la première unité de détermination de température (36-1) et la température déterminée par la troisième unité de détermination de température (38-1) est égale ou supérieure à la première valeur de seuil (T1) et

est configurée pour déterminer si la deuxième différence de température (ΔT_n) entre la température (T2) déterminée par la deuxième unité de détermination de température (36-2, ..., 36-n) et la température déterminée par la quatrième unité de détermination de température (38-2, ..., 38-n) est inférieur à la deuxième valeur de seuil (S152, S156).

3. Système de conditionnement d'air selon la revendication 1,

dans lequel l'unité de commande côté extérieur (28) est configurée pour déterminer si oui ou non

- l'état de connexion pour chacune de la première unité intérieure (30-1) et de la deuxième unité intérieure (30-2, ..., 30-n) a été déterminé (S110);
 sinon, l'unité de commande côté extérieur (28) est configurée pour sélectionner une unité intérieure, dont la détermination de son état de connexion n'a pas été achevée, parmi la première unité intérieure (30-1) et la deuxième unité intérieure (30-2, ..., 30-n), et déterminer son état de connexion.
4. Système de conditionnement d'air selon la revendication 1,
- dans lequel, lorsque la première différence de température (ΔT) est égale ou supérieure à la première valeur de seuil (T1) et la deuxième différence de température (ΔT_n) est égale ou supérieure à la deuxième valeur de seuil (T2), après l'écoulement d'un temps prédéterminé depuis la détermination (S156), lorsque la température (TC) déterminée par la première unité de détermination de température (36-1) fournie correspondant à la première unité intérieure (30-1) est égale ou inférieure à la température (TCn) déterminée par la deuxième unité de détermination de température (36-2, ..., 36-n) fournie correspondant à la deuxième unité intérieure (30-2, ..., 30-n), l'unité de commande est configurée pour déterminer que le premier tuyau de raccordement (2-1-1, 2-1-2) et la première ligne de communication est correctement raccordée (S162, S164).
5. Système de conditionnement d'air selon la revendication 1, comprenant en outre :
- une troisième unité intérieure (32-3) ayant un troisième échangeur de chaleur (32-3) et pouvant être raccordée à une pluralité de tuyaux de raccordement (2-1-1, 2-1-2, ..., 2-n-2) ;
 une cinquième unité de détermination de température (36-3) configurée pour déterminer la température du troisième échangeur de chaleur (32-3); et
 une sixième unité de détermination de température (38-3) prévue pour la troisième unité intérieure (30-3) et configuré pour déterminer la température d'un espace cible de conditionnement d'air associé à la troisième unité intérieure (30-3),
 dans lequel, lorsqu'il est déterminé que le premier tuyau de raccordement (2-1-1, 2-1-2) et la première ligne de communication raccordée à la première unité intérieure (30-1) est correctement raccordée,
 dans un cas où une troisième différence de température (ΔT) entre la température déterminée par la deuxième unité de détermination de température (36-2) et la température déterminée par la quatrième unité de détermination de température (38-2) est égale ou supérieure à la première valeur de seuil (T1) et une quatrième différence de température (ΔT_n) entre la température déterminée par la cinquième unité de détermination de température (36-3) et la température déterminée par la sixième unité de détermination de température (38-3) est inférieure à la deuxième valeur de seuil (T2), l'unité de commande est configurée pour déterminer que le deuxième tuyau de raccordement (2-2-1, 2-2-2) raccordé à la deuxième unité intérieure (30-2) et une deuxième ligne de communication raccordée à la deuxième unité intérieure (30-2) est correctement raccordé.
6. Système de conditionnement d'air selon la revendication 1,
- dans lequel, lorsqu'il est déterminé que le premier tuyau de raccordement (2-1-1, 2-1-2) et la première ligne de communication raccordée à la première unité intérieure (30-1) est correctement raccordé, l'unité de commande n'utilise pas la température déterminée par la première détermination de température (36-1) et la température déterminée par la troisième unité de détermination de température (38-1), lors de la détermination si le deuxième tuyau de raccordement (2-2-1, 2-2-2) connecté à la deuxième unité intérieure (30-2) et la deuxième ligne de communication raccordée à la deuxième unité intérieure (30-2) est correctement raccordé.
7. Système de conditionnement d'air selon la revendication 1,
- dans lequel l'unité de commande est configurée pour commander au moins le deuxième ventilateur soufflant (34-2, ..., 34-n) dans un état MARCHE, pendant l'intervalle de temps après la détermination de l'état de connexion de la première unité intérieure (30-1).

FIG. 1

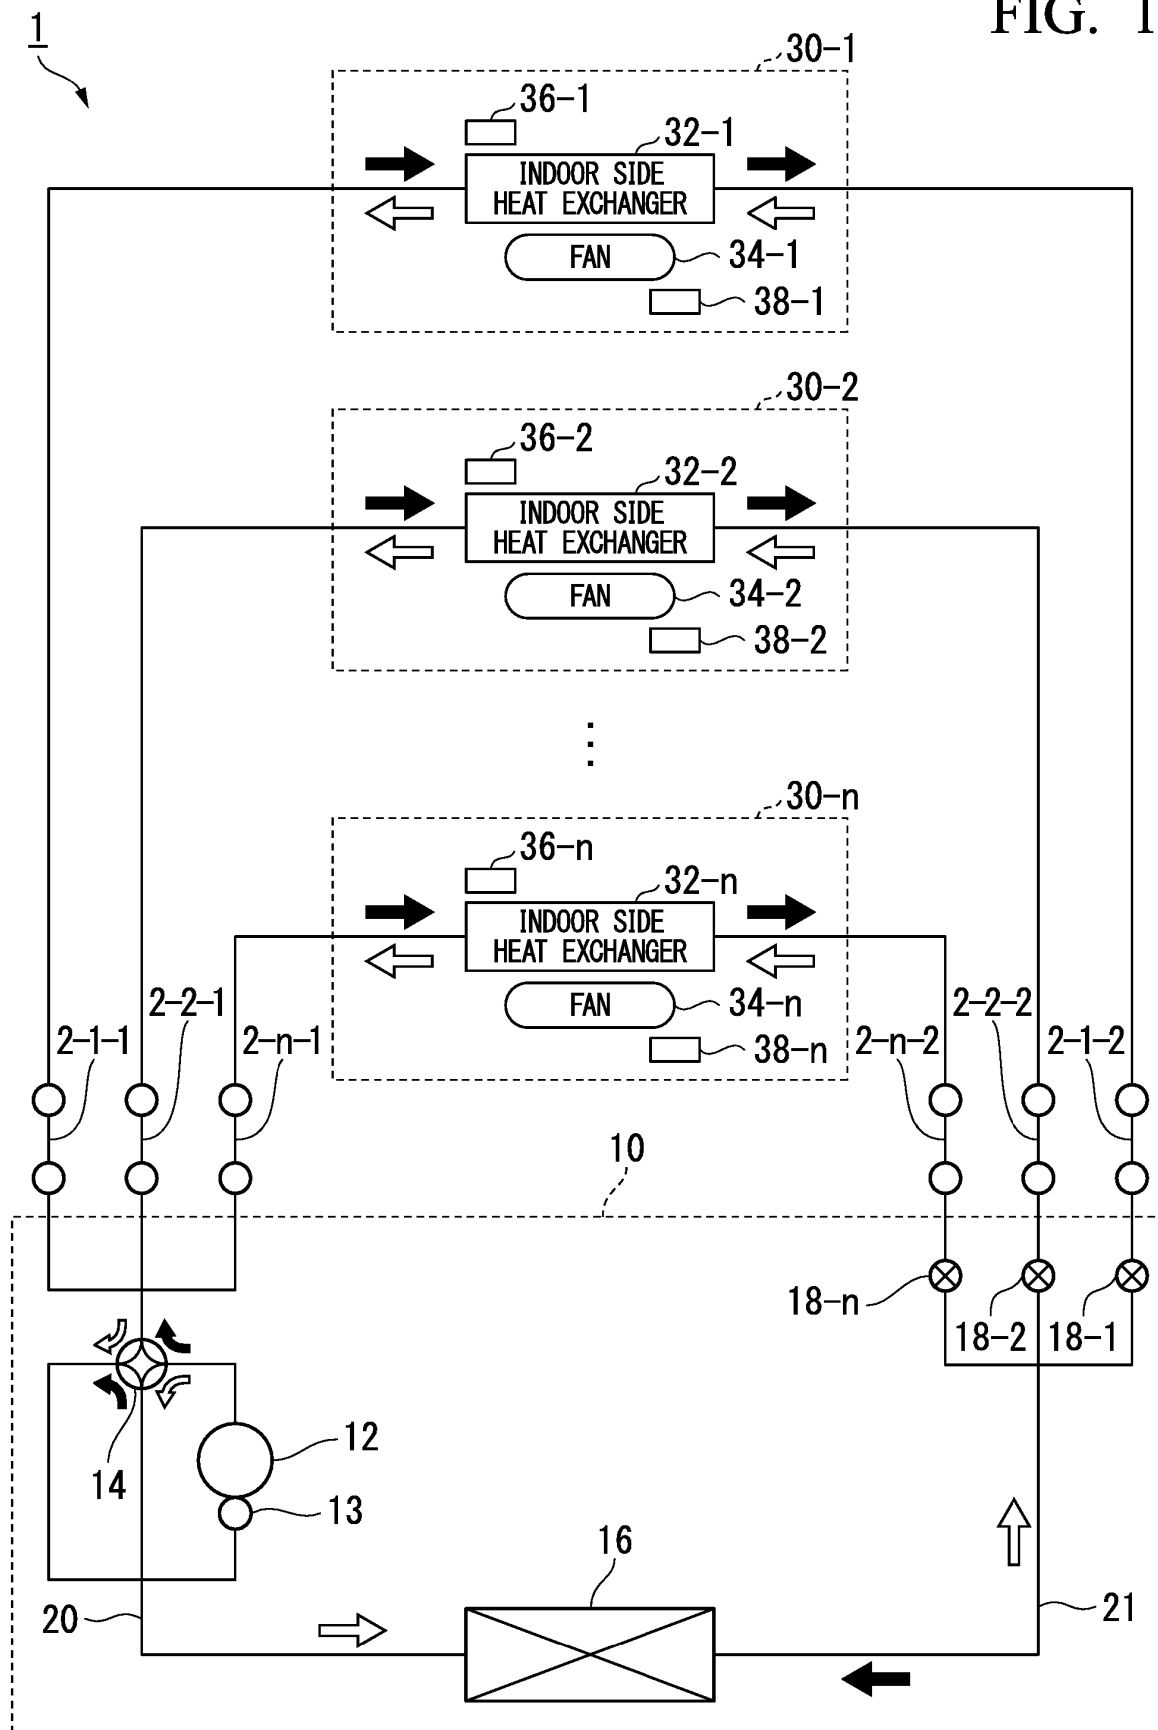


FIG. 2

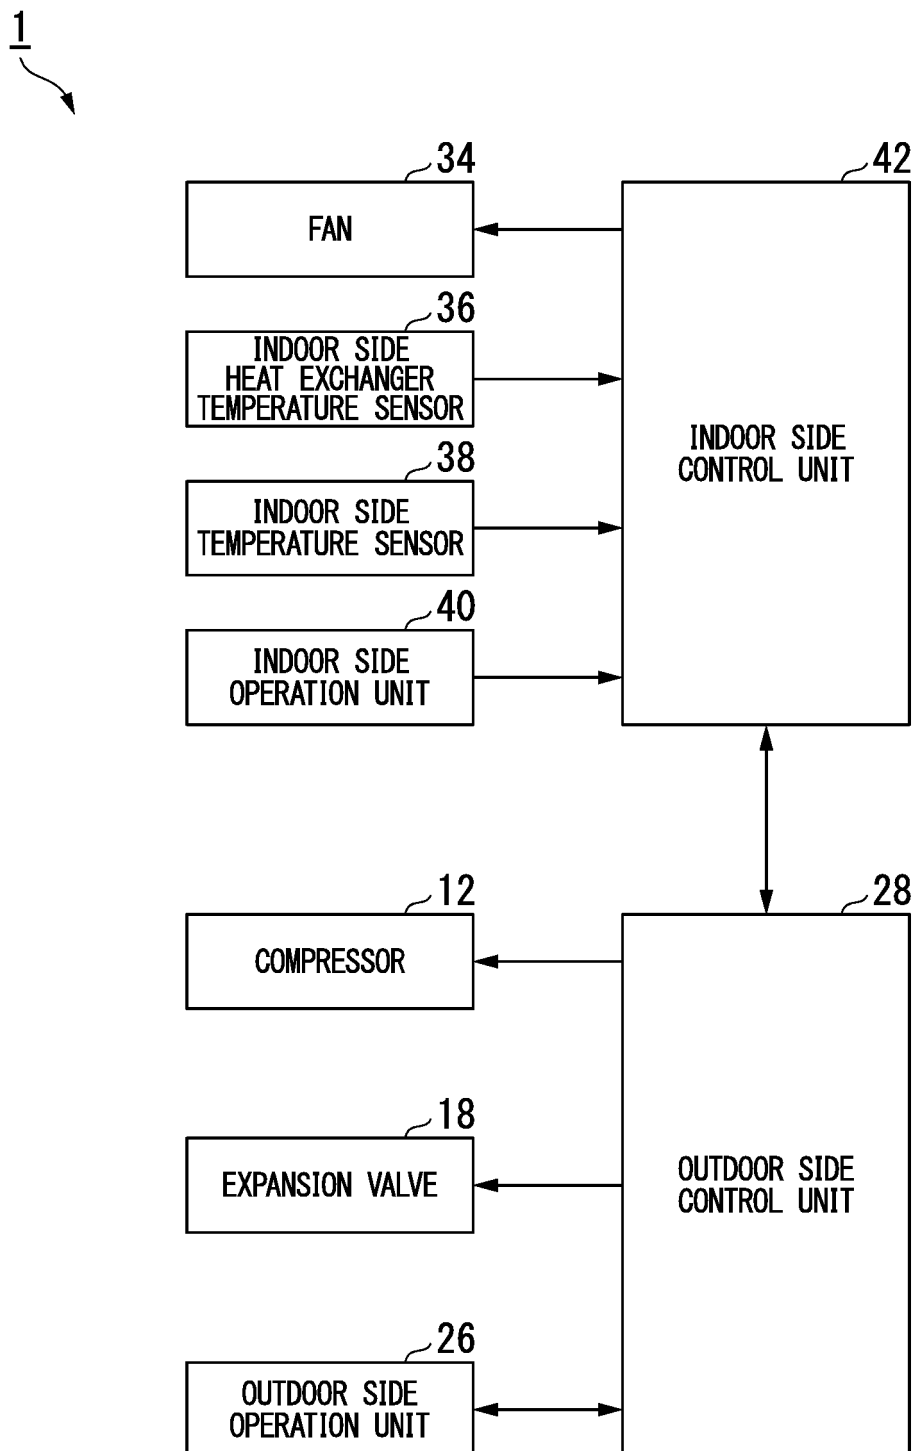


FIG. 3

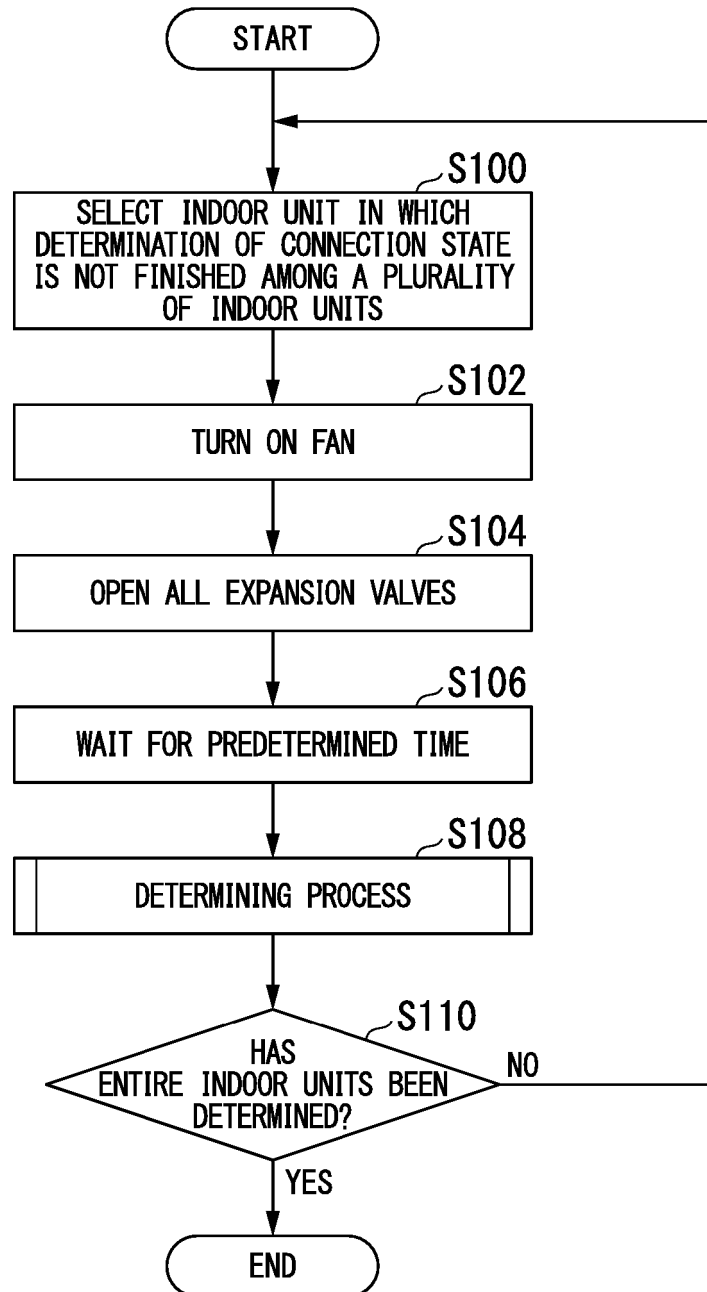


FIG. 5

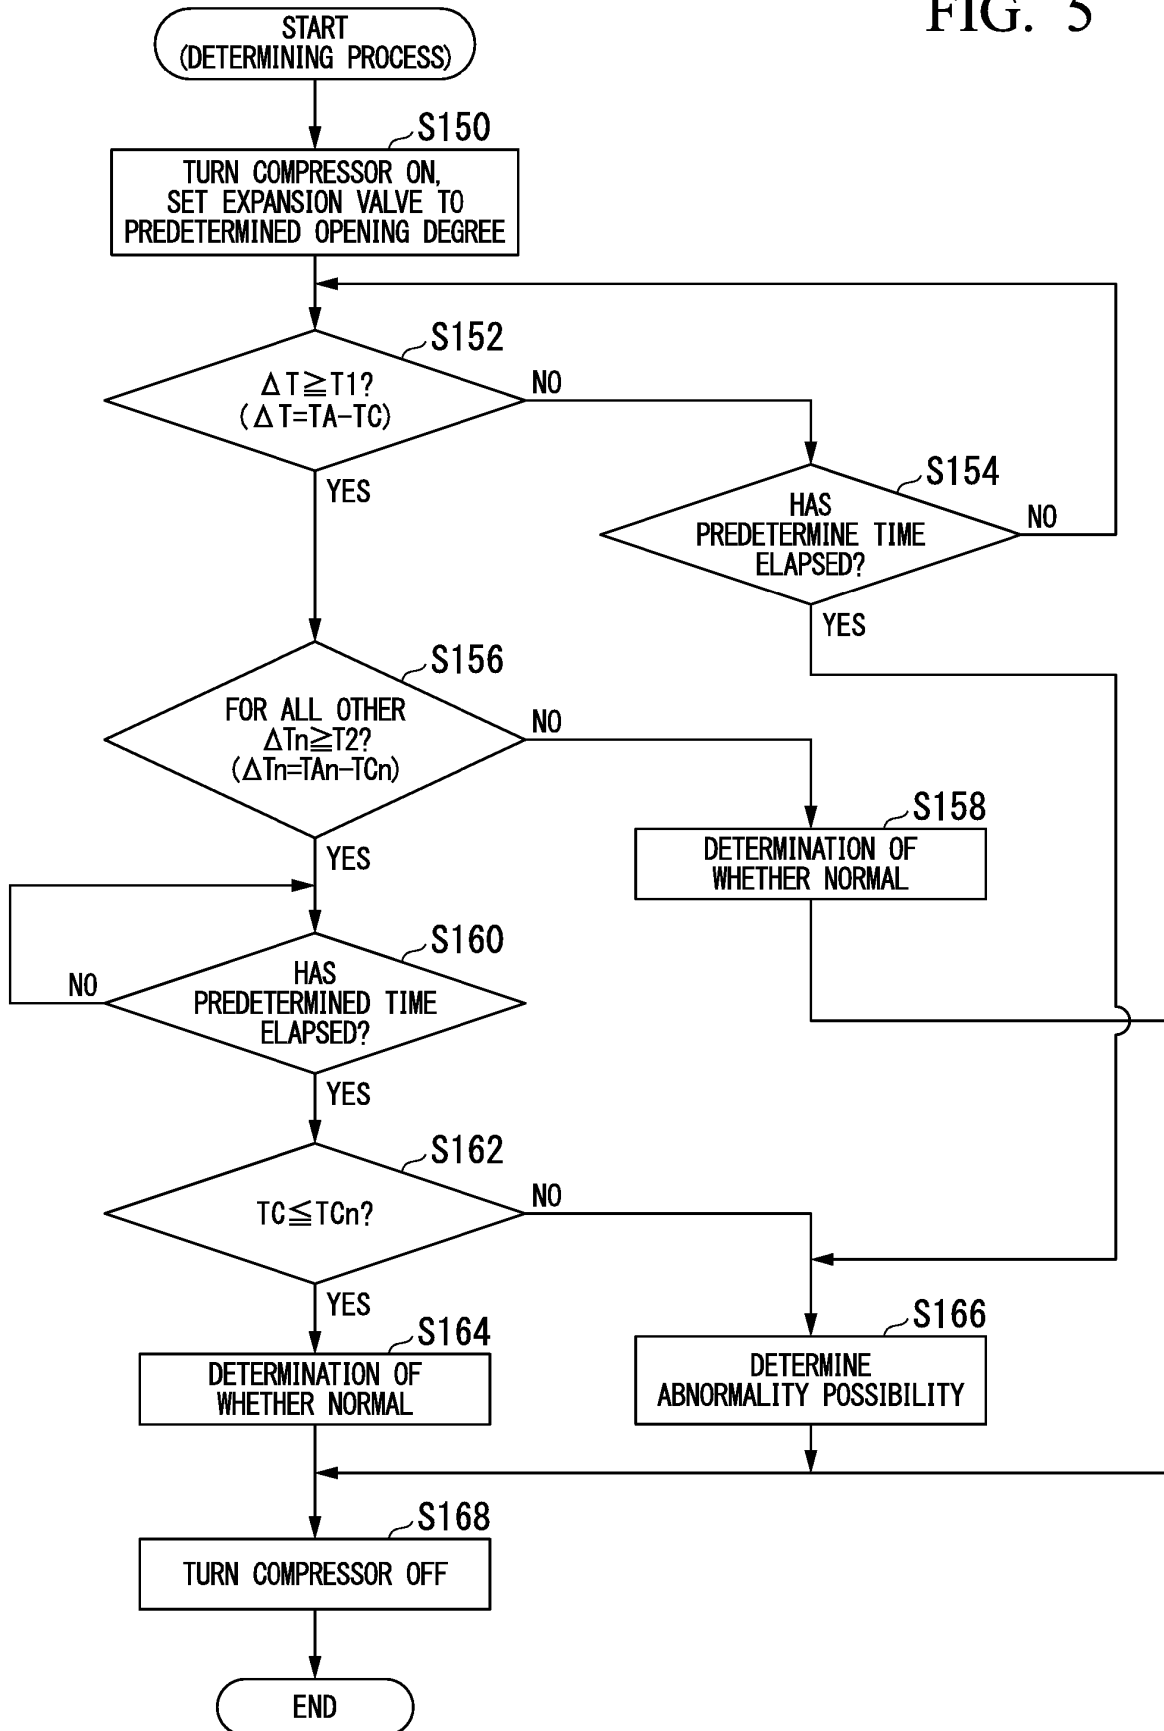


FIG. 6


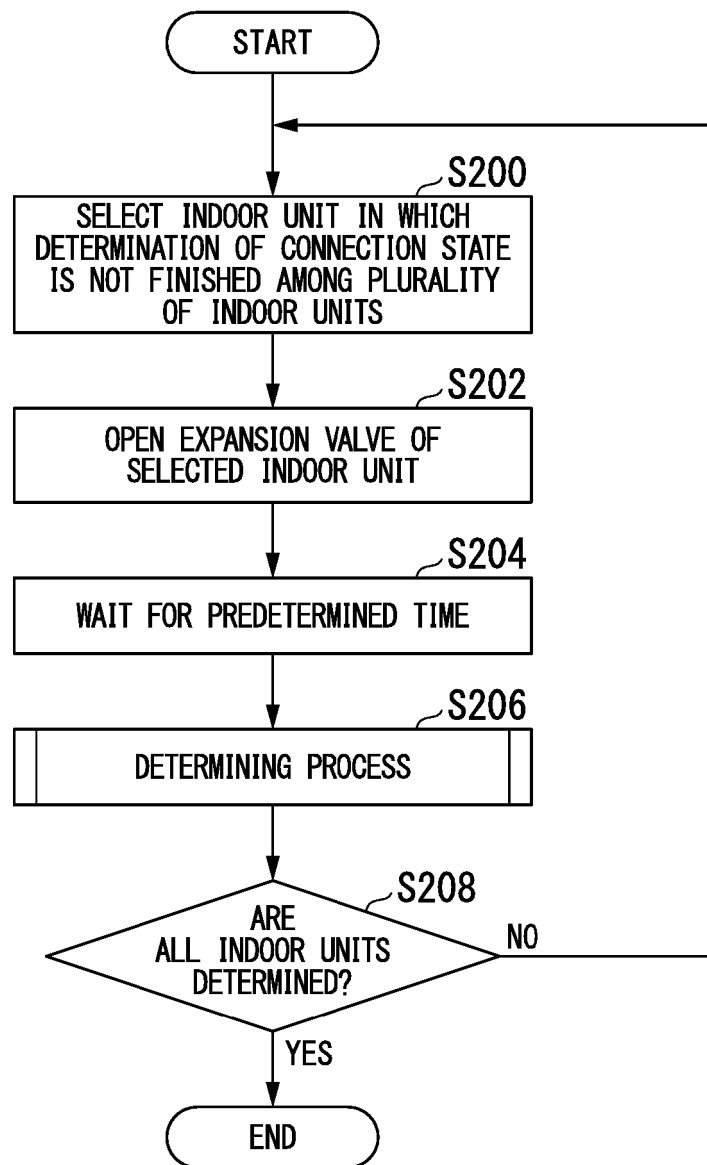


FIG. 7

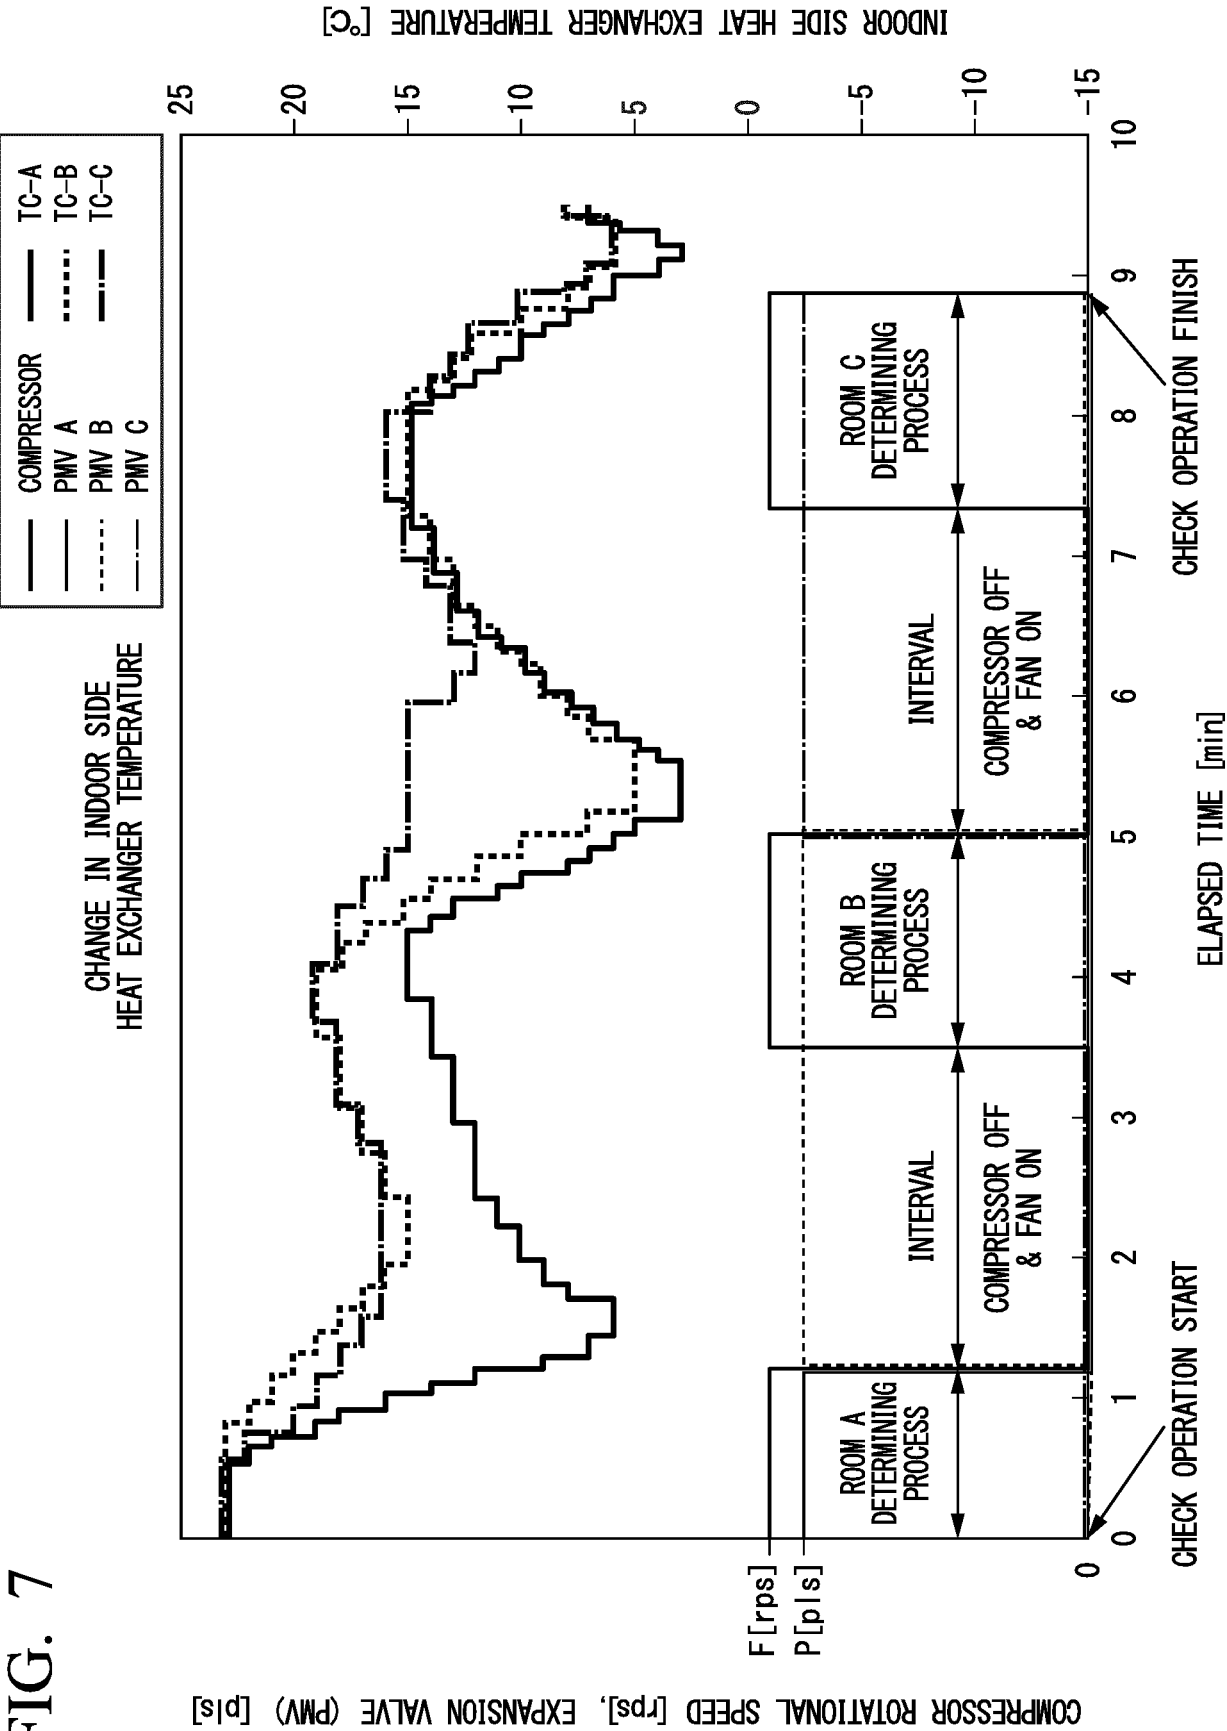

REFERENCES CITED IN THE DESCRIPTION

This list of references cited by the applicant is for the reader's convenience only. It does not form part of the European patent document. Even though great care has been taken in compiling the references, errors or omissions cannot be excluded and the EPO disclaims all liability in this regard.

Patent documents cited in the description

- JP 2015221940 A [0002]
- JP 3216435 B [0003]
- JP H533982 A [0004]